

Thermal Overload Relays

TR series

■ Features

● Manual trip


These relays can be manually tripped for sequence inspection by pressing manual trip bar (TR-0N/3, TR-5-1N/3). A sequence inspection will be performed when the test button is pulled out. When the test button is pressed in, only the NC contact will turn OFF. The original status will be restored when the test button is then released. (TR-N2/3 to N8/3)

● Trip-free mechanism

Even if the reset button is carelessly pressed, this relay trips without trouble (Trip-free mechanism).


● Easy visual checking of operating status

Trip indicator and manual trip bar permit visual check of tripping status.

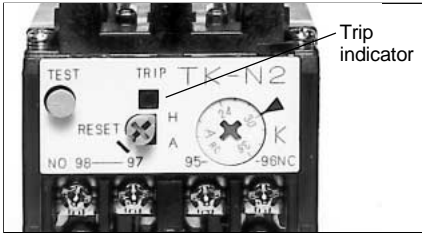

● Dial ampere setting

The setting dial uses a RC (Rated Current) marking which is set to the motor full load current.

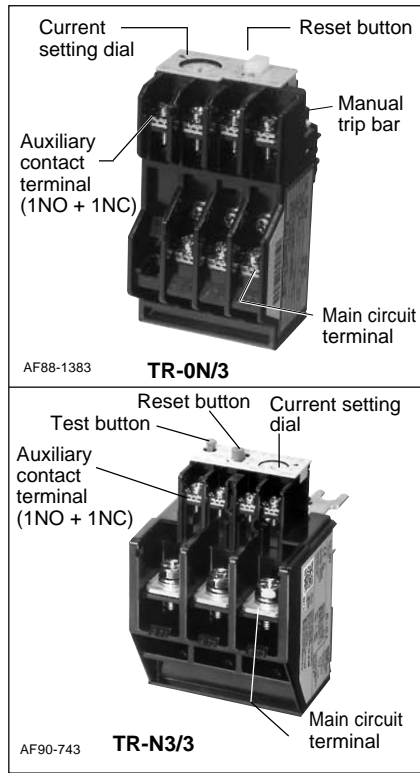

■ Versatile optional accessories


Trip indicator



Reset release



Base unit for separate mounting



■ Optional accessories

Description	Type	Ordering code	Used with thermal overload relay
Reset release	Lead length 300 mm 500 mm 700 mm	SZ-R1	TZ1R1
		SZ-R2	TZ1R2
		SZ-R3	TZ1R3
You can reset these relays remotely on the front panels of switchboards.	Lead length 300 mm 500 mm 700 mm	SZ-R4	TZ2R4
		SZ-R5	TZ2R5
		SZ-R6	TZ2R6
Trip indicator	100–110V AC 50/60Hz 200–220V AC 50/60Hz	SZ-L100	TZ1L100
		SZ-L200	TZ1L200
Easier checking of trip status	100–110V AC 50/60Hz 200–220V AC 50/60Hz	SZ-L100N2	TZ2L100N2
		SZ-L200N2	TZ2L200N2
Dial cover For protection against the current setting being changed in error	SZ-DA	SZ1DA	TR-0N/3, TR-5-1N/3, TK-0N, TK-5-1N TR-N2/3 to N14/3, TK-N2 to N14
Base unit for separate mounting The unit can be screw-mounted and rail-mounted.	SZ-HB	TZ1HB	TR-0N/3, TK-0N
	SZ-HC	TZ1HC	TR-5-1N/3, TK-5-1N
	SZ-HD	TZ2HD	TR-N2/3, TK-N2
	SZ-HE	TZ2HE	TR-N3/3, TK-N3
Terminal cover	SZ-T10	SZ1T10	Base unit for separate mounting SZ-HB
	SZ-T11	SZ1T11	Base unit for separate mounting SZ-HC
	SZ-T14	SZ2T14	For separate mounting TR-N2H/3, TK-N2H
	SZ-T15	SZ2T15	For separate mounting TR-N3H/3, TK-N3H
	SZ-RN6T	SZ2RN6T	For separate mounting TR-N6H/3, TK-N6H
	SZ-T12	TZ1T12	TR-0N/3, TK-0N
	SZ-T13	TZ1T13	TR-5-1N/3, TK-5-1N
	SZ-T16	SZ2T16	TR-N2/3, TK-N2
	SZ-T17	SZ2T17	TR-N3/3, TK-N2

■ Selection guide/Standard type

On-contactor mounting	3-element	TR-0N/3 (TR13DW) TR-0N (TR13NW)		TR-5-1N/3 (TR20DW) TR-5-1N (TR20NW)		TR-N2/3 (TR35BDW) TR-N2 (TR35BNW)		TR-N3/3 (TR65BDW) TR-N3 (TR65BNW)	
	2-element	TR-0NH/3 (TR13DH) TR-0NH (TR13NH)		TR-5-1NH/3 (TR20DH) TR-5-1NH (TR20NH)		TR-N2H/3 (TR35BDH) TR-N2H (TR35BNH)		TR-N3H/3 (TR65BDH) TR-N3H (TR65BNH)	
Separate mounting	3-element	TR-0N/3 (TR13DW) TR-0N (TR13NW)		TR-5-1N/3 (TR20DW) TR-5-1N (TR20NW)		TR-N2/3 (TR35BDW) TR-N2 (TR35BNW)		TR-N3/3 (TR65BDW) TR-N3 (TR65BNW)	
Separate mounting	2-element	TR-0NH/3 (TR13DH) TR-0NH (TR13NH)		TR-5-1NH/3 (TR20DH) TR-5-1NH (TR20NH)		TR-N2H/3 (TR35BDH) TR-N2H (TR35BNH)		TR-N3H/3 (TR65BDH) TR-N3H (TR65BNH)	
Contactor to be combined		SC-03	SC-0 SC-05	SC-4-0	SC-4-1 SC-5-1	SC-N1	SC-N2	SC-N2S	SC-N3
Ampere setting range (A)	Code	A	0.1 – 0.15	0.1 – 0.15	0.1 – 0.15	0.1 – 0.15			
	B	0.13 – 0.2	0.13 – 0.2	0.13 – 0.2	0.13 – 0.2				
	C	0.15 – 0.24	0.15 – 0.24	0.15 – 0.24	0.15 – 0.24				
	D	0.2 – 0.3	0.2 – 0.3	0.2 – 0.3	0.2 – 0.3				
	E	0.24 – 0.36	0.24 – 0.36	0.24 – 0.36	0.24 – 0.36				
	F	0.3 – 0.45	0.3 – 0.45	0.3 – 0.45	0.3 – 0.45				
	G	0.36 – 0.54	0.36 – 0.54	0.36 – 0.54	0.36 – 0.54				
	H	0.48 – 0.72	0.48 – 0.72	0.48 – 0.72	0.48 – 0.72				
	J	0.64 – 0.96	0.64 – 0.96	0.64 – 0.96	0.64 – 0.96				
	K	0.8 – 1.2	0.8 – 1.2	0.8 – 1.2	0.8 – 1.2				
	L	0.95 – 1.45	0.95 – 1.45	0.95 – 1.45	0.95 – 1.45				
	M	1.4 – 2.2	1.4 – 2.2	1.4 – 2.2	1.4 – 2.2				
	N	1.7 – 2.6	1.7 – 2.6	1.7 – 2.6	1.7 – 2.6				
	P	2.2 – 3.4	2.2 – 3.4	2.2 – 3.4	2.2 – 3.4				
	R	2.8 – 4.2	2.8 – 4.2	2.8 – 4.2	2.8 – 4.2				
	S	4 – 6	4 – 6	4 – 6	4 – 6	4 – 6	4 – 6		
	T	5 – 8	5 – 8	5 – 8	5 – 8	5 – 8	5 – 8		
	U	6 – 9	6 – 9	6 – 9	6 – 9	6 – 9	6 – 9		
	V	7 – 11	7 – 11	7 – 11	7 – 11	7 – 11	7 – 11	7 – 11	7 – 11
	W		9 – 13	9 – 13	9 – 13	9 – 13	9 – 13	9 – 13	9 – 13
X			12 – 18	12 – 18	12 – 18	12 – 18	12 – 18	12 – 18	
Q				16 – 22					
B						18 – 26	18 – 26	18 – 26	
E						24 – 36	24 – 36	24 – 36	
F								28 – 40	
I							32 – 42		
G								34 – 50	
J								45 – 65	
O								48 – 68	
L								53 – 80*	
M								65 – 95*	
I								85 – 105*	

On-contactor mounting	3-element	TR-N5/3 (TR80BDW) TR-N5 (TR80BNW)		TR-N6/3 (TR1CBDW) TR-N6 (TR1CBNW)	TR-N7/3 (TR1FBDW) TR-N7 (TR1FBNW)	TR-N8/3 (TR1JBDW) TR-N8 (TR1JBNW)	TR-N10/3 (TR2CBDW) TR-N10 (TR2CBNW)	TR-N12/3 (TR4ABDW) TR-N12 (TR4ABNW)	TR-N14/3 (TR8ABDW) TR-N14 (TR8ABNW)
	2-element	TR-N6H/3 (TR1CBDH) TR-N6H (TR1CBNH)		–	–	–	TR-N10H/3 (TR2CBDH) TR-N10H (TR2CBNH)	TR-N12H/3 (TR4ABDH) TR-N12H (TR4ABNH)	TR-N14H/3 (TR8ABDH) TR-N14H (TR8ABNH)
Separate mounting	3-element	–		TR-N6H/3 (TR1CBDH) TR-N6H (TR1CBNH)	–	–	TR-N10H/3 (TR2CBDH) TR-N10H (TR2CBNH)	TR-N12H/3 (TR4ABDH) TR-N12H (TR4ABNH)	TR-N14H/3 (TR8ABDH) TR-N14H (TR8ABNH)
Separate mounting	2-element	–		TR-N6H/3 (TR1CBDH) TR-N6H (TR1CBNH)	–	–	TR-N10H/3 (TR2CBDH) TR-N10H (TR2CBNH)	TR-N12H/3 (TR4ABDH) TR-N12H (TR4ABNH)	TR-N14H/3 (TR8ABDH) TR-N14H (TR8ABNH)
Contactor to be combined		SC-N4	SC-N5A	SC-N6	SC-N7	SC-N8	SC-N10	SC-N11	SC-N12
Ampere setting range (A)	Code	B	18 – 26	18 – 26					
	E	24 – 36	24 – 36						
	F	28 – 40	28 – 40						
	G	34 – 50	34 – 50						
	J	45 – 65	45 – 65	45 – 65	45 – 65				
	L	53 – 80	53 – 80	53 – 80	53 – 80				
	M		65 – 95	65 – 95	65 – 95	65 – 95			
	I		85 – 105						
	N			85 – 125	85 – 125	85 – 125	85 – 125		
	P			110 – 160*	110 – 160	110 – 160	110 – 160	110 – 160	110 – 160
	R					125 – 185	125 – 185	125 – 185	125 – 185
	S						160 – 240	160 – 240	160 – 240
	T							200 – 300	200 – 300
	U								240 – 360
V								300 – 450	
W								400 – 600	

- Notes: • TR-N10/3 to N14/3 types are provided with CTs.
 • Max. setting ranges of these starters are as shown in the table on the right.
 • When ordering the thermal overload relays for starter use, select the applicable setting range.
 (): Basic ordering code (When ordering phase-loss protective type, enter the version code E instead of D)
 *: Separate mounting only

Motor starter	Maximum applicable heater range (A)	
	200–240V	380–440V
SW-03/3H	7–11	6–9
SW-4-0/3H	12–18	12–18
SW-N1/3H	24–36	24–36
SW-N2S/3H	34–50	34–50
SW-N4/3H	53–80	53–80
SW-N6/3H	85–125	85–125