




TSX 17 Micro-PLCs

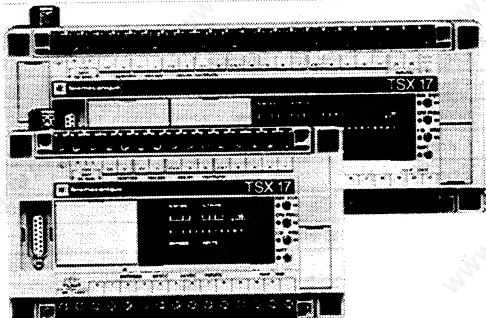


TSX 17-10
20/34/40 I/O
24 VDC inputs
relay/transistor outputs
PL7-1 language

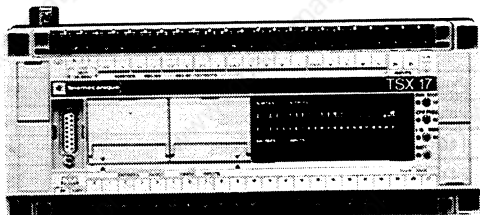

TSX 17-20
20/34/40 I/O
24 VDC/110 VAC inputs
relay/transistor outputs
PL7-1 or PL7-2 languages

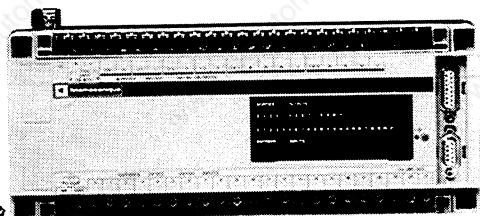

Extension block
30/40 I/O
24 VDC/110 VAC inputs
relay/transistor outputs



Discrete I/O extension module

- 6 24 VDC/110 VAC inputs
- 6 relay/triac/transistor outputs

Extension modules

- 4 analog inputs/2 analog outputs
- 4 analog timers
- Uni-Telway Bus

Contents

TSX 17 Micro-PLC Installation Manual

| Section | Sub-section | Page |
|------------------------------|---|------|
| 1. Planning the Installation | 1.1 TSX 17 Micro-PLC Description | 4 |
| | 1.2 Discrete I/O Extension Blocks | 13 |
| | 1.3 Discrete I/O Extension Modules | 16 |
| | 1.4 Mains Power Break/Return | 17 |
| | 1.5 Catalog Information (Accessories) | 19 |
| | 1.6 Specific I/O | 20 |
| | 1.7 PL7-2 Software Cartridges | 20 |
| | 1.8 Saving Programs and Data | 21 |
| | 1.9 I/O Addressing | 24 |
| 2. Mounting | 2.1 Building a Configuration | 25 |
| | 2.2 Configuration Examples | 26 |
| | 2.3 Basic PLC/Extension Compatibility | 28 |
| | 2.4 Dimensions | 29 |
| | 2.5 Mounting Considerations | 30 |
| 3. Wiring | 3.1 Power Supplies | 31 |
| | 3.2 24VDC Inputs, Relay Outputs | 34 |
| | 3.3 110VAC Inputs, Relay Outputs | 36 |
| | 3.4 24VDC Inputs, Transistor Outputs | 38 |
| | 3.5 Extension Module I/O | 42 |
| | 3.6 2 and 3-Wire Detector Connection Examples | 43 |
| | 3.7 Event Triggered Inputs | 44 |
| | 3.8 Fast Counter | 45 |
| | 3.9 Wiring the I/O | 46 |

Contents

TSX 17 Micro-PLC Installation Manual

| Section | Sub-section | Page |
|--|--|-------------|
| 4. Setting into Service - Maintenance | 4.1 Initial Power-up Procedure | 47 |
| | 4.2 Checking the I/O Connections | 48 |
| | 4.3 Troubleshooting Using the Indicator Lights | 49 |
| 5. Technical Characteristics | 5.1 Power Supply Characteristics | 51 |
| | 5.2 Discrete Input Characteristics | 51 |
| | 5.3 TSX 17-20 Event Triggered and Fast Counting Input Characteristics | 52 |
| | 5.4 Discrete Output Characteristics | 53 |
| | 5.5 Compatibility with Telemecanique Sensors | 56 |
| | 5.6 Compatibility with Telemecanique Actuators | 58 |
| 6. Service Conditions | 6.1 Standards | 59 |
| | 6.2 Environment - Normal Service Conditions | 59 |
| | 6.3 Reliability | 60 |
| | 6.4 Safety - System Availability | 61 |
| 7. Appendix | 7.1 Isolation Transformer Equipped Power Supply | 62 |
| | 7.2 TSX 17 ACC2 Display | 63 |

1 Planning the Installation


1.1 TSX 17 Micro-PLC Description

Basic TSX 17-10 Micro-PLC, TSX 171 2028

20 discrete I/O, 24VDC inputs, relay outputs. AC power supply.

This system comprises:

- a 110/240VAC power supply ① that provides a 24VDC, 250mA sensor supply output ②,
- a processor unit with a programming port ③ and a status display ④,
- 8K bytes of internal RAM program memory, that can be battery backed-up. The battery is located in ⑤ and has a 1 year service life,
- a location ⑥ for a plug-in EEPROM or EPROM memory cartridge for saving user programs,
- 20 discrete I/O (12 isolated 24VDC inputs ⑦, 8 relay outputs ⑧) with a front panel status display ⑨,
- a 9-pin I/O bus extension connector ⑩,
- 2 removable terminal blocks with protected screws ⑪,
- a ground connector ⑫.

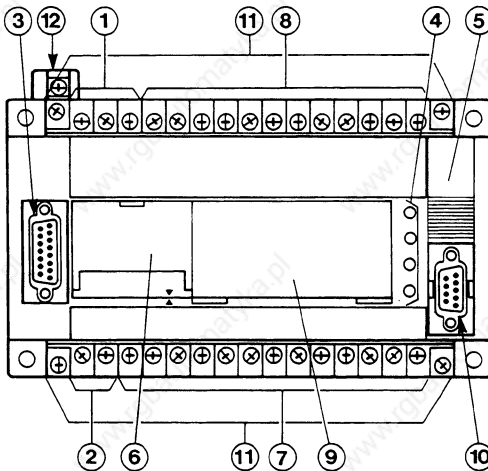

1 Planning the Installation


TSX 17 Micro-PLC Description (Cont'd)

Basic TSX 17-10 Micro-PLC, TSX 171 3428

34 Discrete I/O, 24VDC inputs, relay outputs. AC power supply.

This system comprises:

- a 110/240VAC power supply ① that provides a 24VDC, 250mA sensor supply output ②
- a processor unit with a programming port ③ and a status display, ④
- 8K bytes of internal RAM program memory that can be battery backed-up. The battery is located in ⑤ and has a 1 year service life,
- a location ⑥ for a plug-in EEPROM or EPROM memory cartridge for saving user programs,
- 34 discrete I/O (22 isolated 24VDC inputs ⑦, 12 relay outputs ⑧) with a front panel status display ⑨,
- a 9-pin I/O bus extension connector ⑩,
- 2 removable terminal blocks with protected screws ⑪,
- a ground connector ⑫,

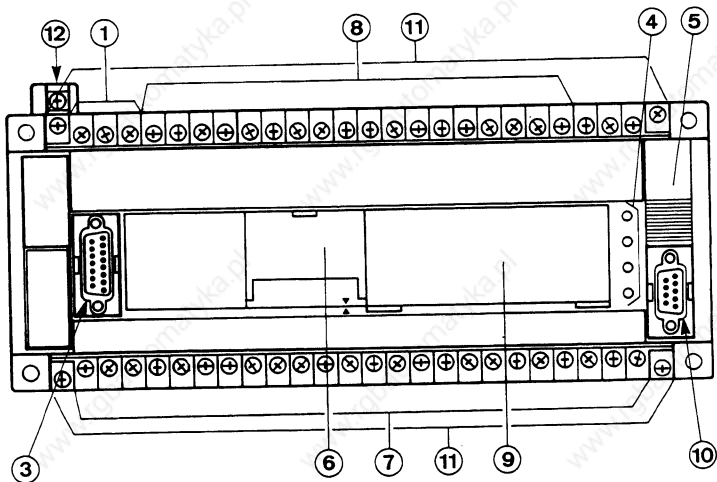

1 Planning the Installation


TSX 17 Micro-PLC Description (Cont'd)

Basic TSX 17-10 Micro-PLC, TSX 171 2002

20 discrete I/O, 24VDC inputs, transistor outputs. DC power supply

This system comprises:

- a 24VDC power supply ①,
- a processor unit with a programming port ③ and a status display ④,
- 8K bytes of internal RAM program memory, that can be battery backed-up. The battery is located in ⑤ and has a 1 year service life,
- a location ⑥ for a plug-in EEPROM or EPROM memory cartridge for saving user programs,
- 20 discrete I/O with a front panel status display ⑨,
 - 12 inputs 24VDC not isolated ⑦,
 - 8 transistor outputs ⑧ not isolated or protected against shorting, providing 2 different output levels:
 - points 0 and 1 (2 outputs): 2 amps,
 - points 2 to 7 (6 outputs): 1 amp,
- a 9-pin I/O bus extension connector ⑩,
- 2 removable terminal blocks with captive screw-terminals ⑪,
- a ground connector ⑫

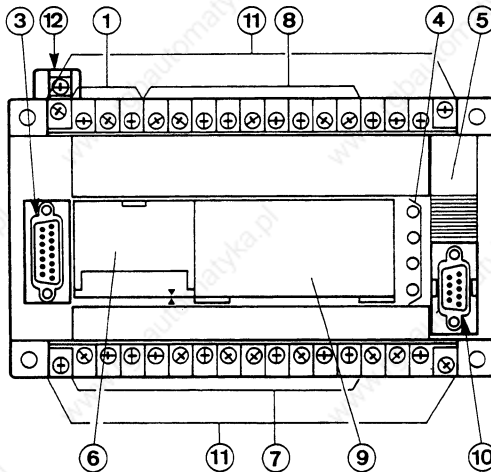

1 Planning the Installation


TSX 17 Micro-PLC Description (Cont'd)

Basic TSX 17-10 Micro-PLC, TSX 171 4002

40 discrete I/O, 24VDC inputs, transistor outputs. DC power supply.

This system comprises:

- a 24VDC power supply ①,
- a processor unit with a programming port ③ and a status display ④,
- 8K bytes of internal RAM program memory, that can be battery backed-up. The battery is located in ⑤ and has a 1 year service life,
- a location ⑥ for a plug-in EEPROM or EPROM memory cartridge for saving user programs,
- 40 discrete I/O with a front panel status display ⑨,
 - 24 inputs, 24VDC not isolated ⑦,
 - 16 transistor outputs ⑧ not isolated or protected against shorting, providing 2 different output levels:
 - points 0 to 3 (4 outputs): 2 amps,
 - points 4 to 15 (12 outputs): 1 amp,
- a 9-pin I/O bus extension connector ⑩,
- 2 removable terminal blocks with captive screw-terminals ⑪,
- a ground connector ⑫.

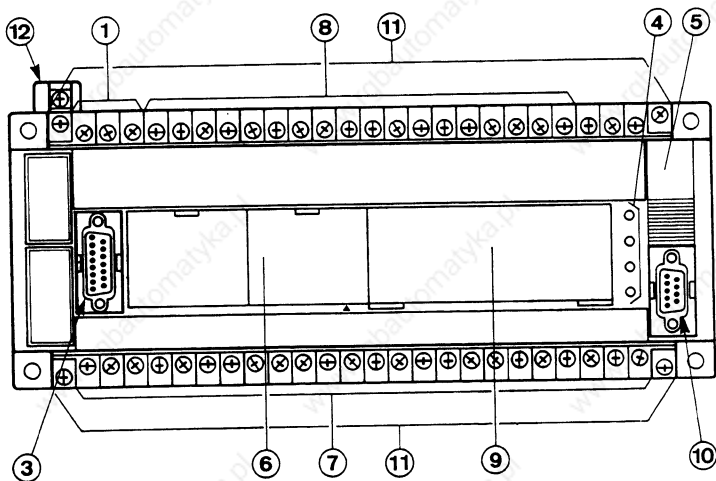

1 Planning the Installation

TSX 17 Micro-PLC Description (Cont'd)

Basic TSX 17-20 Micro-PLC, TSX 172 2028 - TSX 172 3428


20 or 34 Discrete I/O, 24VDC inputs, relay outputs. AC power supply.

These systems comprise:

- a 110/240VAC power supply ① that provides a 24VDC, 250mA supply output ② for sensors connected to the TSX 17,
- a processor unit with programming port ③ and status display ,
- an internal 24K byte RAM program memory (and 2K bytes of data in PL7-2 language), that can be battery backed-up. The battery is located in ⑤ and has a 1 year service life,
- a location ⑥ for a plug-in EEPROM or EPROM memory cartridge for saving user programs,
- a location ④ for a PL7-2 software cartridge. This optional cartridge is required if the user wishes to program in PL7-2 language. To connect the TSX T407 terminal to the TSX 17 programming port a TSX 17 ACC7 line adapter unit is also required,
- 20 or 34 discrete I/O with a front panel status display ⑨.

| PLC | 24VDC isolated inputs | | Relay outputs | |
|--------------|-----------------------|----|---------------|----|
| | ⑦ | ⑦ | ⑧' | ⑧ |
| TSX 172 2028 | 12 | | 8 | |
| TSX 172 3428 | | 22 | | 12 |

- a 9-pin I/O bus extension connector ⑩,
- 2 removable terminal blocks with captive screw-terminals ⑪,
- a ground connector ⑮,
- 2 event-triggered inputs ⑫ (24VDC inputs),
- a 2 KHz fast counter/timer ⑬, with counter and reset inputs (5/24VDC inputs).

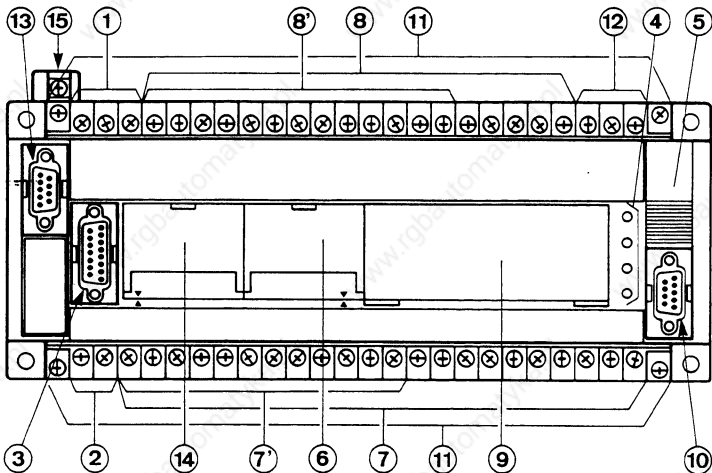

1 Planning the Installation

TSX 17 Micro-PLC Description (Cont'd)

Basic TSX 17-20 Micro-PLC, TSX 172 2044 - TSX 172 3444


20 or 34 Discrete I/O, 110VAC inputs, relay outputs. AC power supply.

These systems comprise:

- a 110/240VAC power supply ① that provides a 24VDC, 250mA supply output ② for sensors connected to the TSX 17,
- a processor unit with programming port ③ and status display ④,
- an internal 24K byte RAM program memory (and 2K bytes of data in PL7-2 language), that can be battery backed-up. The battery is located in ⑤ and has a 1 year service life,
- a location ⑥ for a plug-in EEPROM or EPROM memory cartridge for saving user programs),
- a location ⑭ for a PL7-2 software cartridge. This optional cartridge is required if the user wishes to program in PL7-2 language. To connect the TSX T407 terminal to the TSX 17 programming port a TSX 17 ACC7 line adapter unit is also required,
- 20 or 34 discrete I/O with front panel status display ⑨,

| PLC | 110VAC isolated inputs | | Relay outputs | |
|--------------|------------------------|----|---------------|----|
| | ⑦ | ⑦ | ⑧ | ⑧ |
| TSX 172 2044 | 12 | | 8 | |
| TSX 172 3444 | | 22 | | 12 |

- a 9-pin I/O bus extension connector ⑩,
- 2 removable terminal blocks with captive screw-terminals ⑪,
- a ground connector ⑬,
- a common 110VAC input supply terminal ⑯,
- 2 event-triggered fast inputs ⑫ (24VDC inputs),
- a 2KHz fast counter/timer ⑬, with counter and reset inputs (5/24VDC inputs).

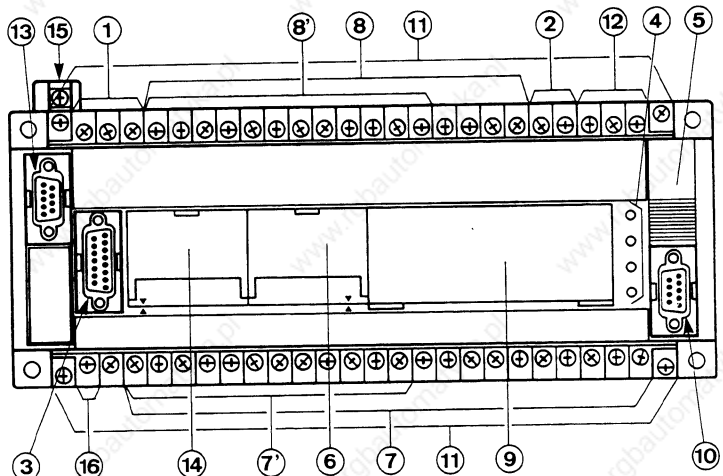

1 Planning the Installation

TSX 17 Micro-PLC Description (Cont'd)

Basic TSX 17-20 Micro-PLC, TSX 172 2012 - TSX 172 4012


20 or 40 Discrete I/O, 24VDC inputs, transistor outputs. DC power supply.

These systems comprise:

- a 24VDC power supply ①,
- a processor unit with programming port ③ and status display ④,
- an internal 24K byte RAM program memory (and 2K bytes of data in PL7-2 language), that can be battery backed-up. The battery is located in ⑤ and has a 1 year service life,
- a location ⑥ for a plug-in EEPROM or EPROM memory cartridge for saving user programs),
- a location ⑭ for a PL7-2 software cartridge. This optional cartridge is required if the user wishes to program in PL7-2 language. To connect the TSX T407 terminal to the TSX 17 programming port a TSX 17 ACC7 line adapter unit is also required,
- 20 or 40 discrete I/O with front panel status display ⑧.

| PLC | 24VDC isolated inputs | | 0.35A isolated and protected transistor outputs | |
|--------------|-----------------------|----|---|----|
| | ⑦ | ⑦ | ⑧ | ⑧ |
| TSX 172 2012 | 12 | | 8 | |
| TSX 172 4012 | | 24 | | 16 |


- a 9-pin I/O bus extension connector ⑩,
- 2 removable terminal blocks with captive screw-terminals ⑪,
- a ground connector ⑬,
- 2 event-triggered fast inputs ⑫ (24VDC inputs),
- a 2KHz fast counter/timer ⑬, with counter and reset inputs (5/24VDC inputs).

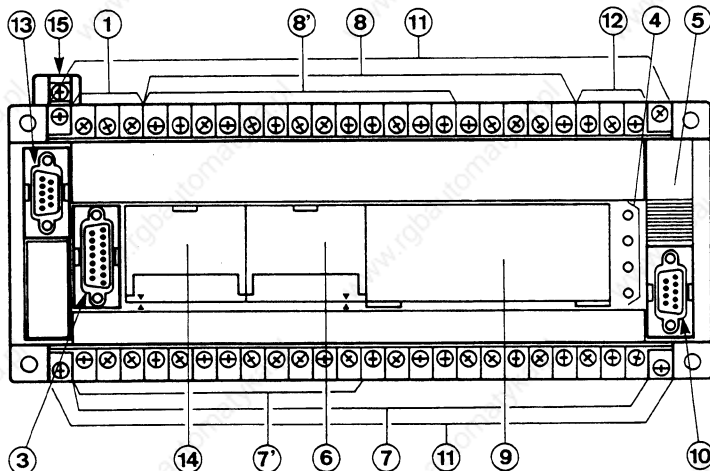

1 Planning the Installation

TSX 17 Micro-PLC Description (Cont'd)


PLC status display



The results of the background self-tests that are run continually by the basic PLC units are displayed on the front panel by four LED indicators.


| | ● Indicator on | ◐ Indicator blinking |
|-----------|----------------|------------------------|
| RUN ● | PLC running | STOP ◐ |
| STOP ◐ | | PLC stopped |
| CPU ● | CPU fault | PROG ◐ |
| PROG ◐ | | Program watchdog fault |
| I/O ● | I/O fault | MEM ◐ |
| MEM ◐ | | RAM memory fault |
| BATT ● | Battery fault | |

I/O status display




In addition to providing a continuous display of the status of the inputs, two output status display functions are also available, depending on the state of system bit SY14 and on the programming language used.


| State of SY 14 | PL7-1 language | PL7-2 language |
|-------------------|---|---|
| 0 (default state) | Display the status of the outputs. | |
| 1 | Display the state of internal bits: B248 to B255 on TSX 171 2028/2002 B240 to B255 on TSX 171 4002 - TSX 172 2012/4012/171 3428 TSX 172 2028/3428 TSX 172 2044/3444 | Display the contents of word SW16 on TSX 172 2012/4012 TSX 172 2028/3428 TSX 172 2044/3444 |

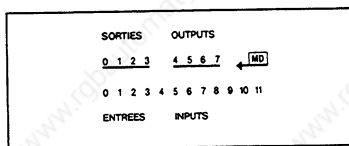


TSX 171 2028/2002

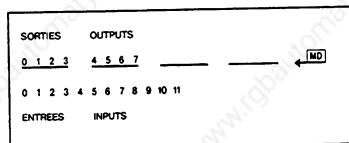

TSX 172 2012/2028/2044

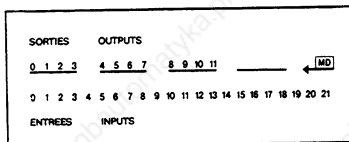

TSX 171 3428 - TSX 172 3428/3444

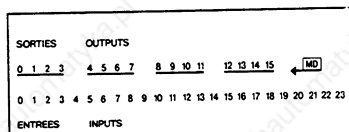

TSX 171 4002 - TSX 172 4012

1 Planning the Installation



TSX 17 Micro-PLC Description (Cont'd)

I/O status display (cont'd)

| Elements displayed | Status SY14 (1) | Language | 0 | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 | 15 |
|--------------------|-----------------|----------------|------------|------------|------------|------------|---------|---|---|---|-----------|---|----|----|-------------|----|----|----|
| | | | 0 1 2 3 | | | | 4 5 6 7 | | | | 8 9 10 11 | | | | 12 13 14 15 | | | |
| Outputs | 0 | PL7-1 PL7-2 | O0,00-- | O0,04-- | O0,08-- | O0,12-- | | | | | | | | | | | | |
| Internal bits | 1 | PL7-1 | B255-- | B251-- | B247-- | B243-- | | | | | | | | | | | | |
| Word SY16 | 1 | PL7-2 | 4th nibble | 3rd nibble | 2nd nibble | 1st nibble | | | | | | | | | | | | |

- (1) The state of system bit SY14 is displayed on the front panel by the MD indicator:
 SY14 = 0 MD indicator off (state taken by default),
 SY14 = 1 MD indicator on.

TSX 17 ACC 2 - Digital display module for use with the basic TSX 17-20 PLC, for PL7-2 language programming

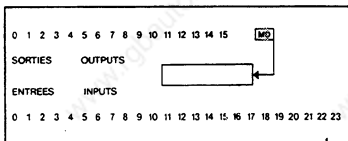



This display module is plugged in as a direct replacement for the standard display module fitted to the TSX 17-20. In addition to the I/O status display, this module comprises a 4 digit BCD display showing the content of word SW 16, if SY 14 = 1.

Depending on the program, the content displayed can be the value of a counter, timer, step number, etc. (refer to the example in sub-section 7-2).

| SY 14 status | 4 digit display | Output status display |
|--------------|-----------------|-----------------------|
| 0 | Inactive | Active |
| 1 | Active | Inactive |

Fitting the display module

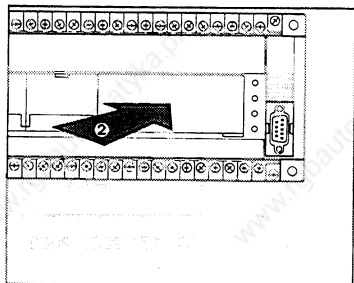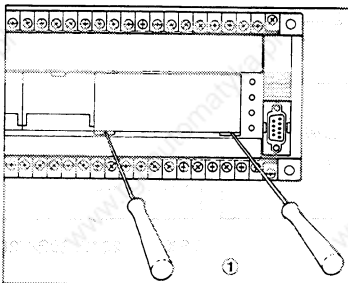

- ① Use a screwdriver to remove the original display unit. ② Insert the digital display unit and press down firmly.

These steps should only be performed with the PLC powered-down.

1 Planning the Installation

1.2 Discrete I/O Extension Blocks

TSX DMF 342 A extension block

34 discrete I/O, 24VDC inputs, relay outputs. AC power supply.


This extension block comprises:

- a 110/240VAC power supply ① that provides a 24VDC, 250mA sensor supply output ②,
- 34 discrete I/O with a front panel status display ⑤,
 - 22 isolated 24VDC inputs ③,
 - 12 relay outputs ④,
- an I/O bus connection or extension block fault LED ⑩,
- a 15-pin I/O bus input connector ⑥,
- a 9-pin I/O bus output connector ⑦,
- 2 removable terminal blocks with captive screw-terminals ⑧,
- a ground connector ⑨,

Maximum extension configurations:

- 2 extension blocks on a TSX 17-10 or TSX 17-20 using PL7-1 language,
- 3 extension blocks on a TSX 17-20 using PL7-2 language.

Refer to the compatibility rules on page 28.

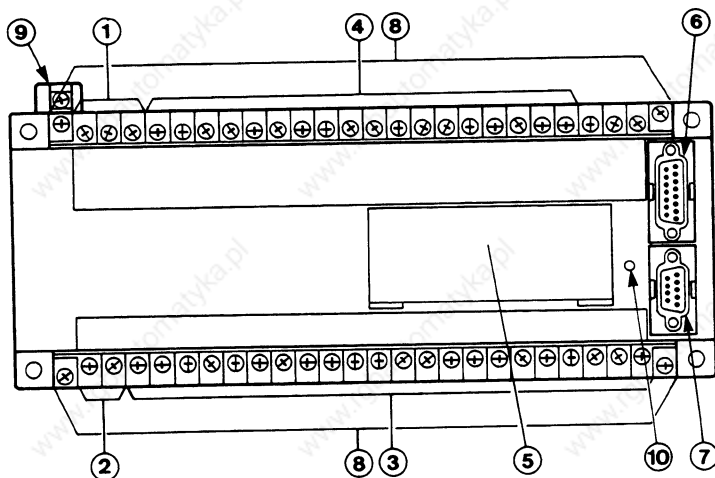

1 Planning the Installation

Discrete I/O Extension Blocks (Cont'd)

TSX DMF 344 A extension block

34 discrete I/O, 110VAC inputs, relay outputs. AC power supply.


This extension block comprises:

- a 110/240VAC power supply ① that provides a 24VDC, 250mA sensor supply output ②,
- 34 discrete I/O with a front panel status display ⑤,
 - 22 isolated 110VAC inputs ③,
 - 12 relay outputs ④,
- an I/O bus connection or extension block fault LED ⑩,
- a 15-pin I/O bus input connector ⑥,
- a 9-pin I/O bus output connector ⑦,
- 2 removable terminal blocks with captive screw-terminals ⑧,
- a ground connector ⑨,
- a common 110VAC input supply terminal ⑪,

Maximum extension configurations:

- 2 extension blocks on a TSX 17-10 or TSX 17-20 using PL7-1 language,
- 3 extension blocks on a TSX 17-20 using PL7-2 language.

Refer to the compatibility rules on page 28.

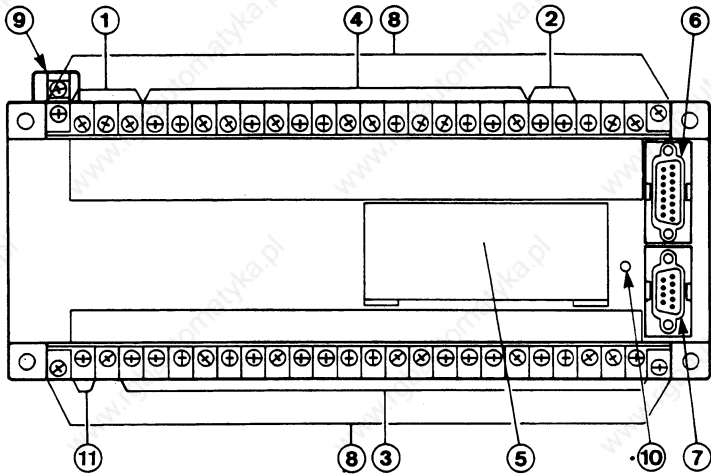

1 Planning the Installation

Discrete I/O Extension Blocks (Cont'd)

TSX DMF 400 - TSX DMF 401 extension blocks

40 discrete I/O, 24VDC inputs, transistor outputs. DC power supply.

These extension blocks comprise:

- two screw terminals for connecting a 24VDC power supply input ①,
- 40 discrete I/O with a front panel status display ⑤.

| Extension blocks | 24 VDC inputs ③ | | Transistor outputs ④ | |
|------------------|-----------------|----------|-----------------------------------|--------------------------|
| | not isolated | isolated | not isolated not protected 1 & 2A | isolated protected 0.35A |
| TSX DMF 400 | 24 | — | 16 ① | — |
| TSX DMF 401 | — | 24 | — | 16 |


(1) points 0 to 3 (4 outputs): 2 amps,
points 4 to 15 (12 outputs): 1 amp.

- an I/O bus connection or extension block fault LED ⑩,
- a 15-pin I/O bus input connector ⑥,
- a 9-pin I/O bus output connector ⑦,
- 2 removable terminal blocks with captive screw-terminals ⑧
- a ground connector ⑨.

Maximum extension configurations:

- 2 extension blocks on a TSX 17-10 or TSX 17-20 using PL7-1 language,
- 3 extension blocks on a TSX 17-20 using PL7-2 language.

Refer to the compatibility rules on page 28.

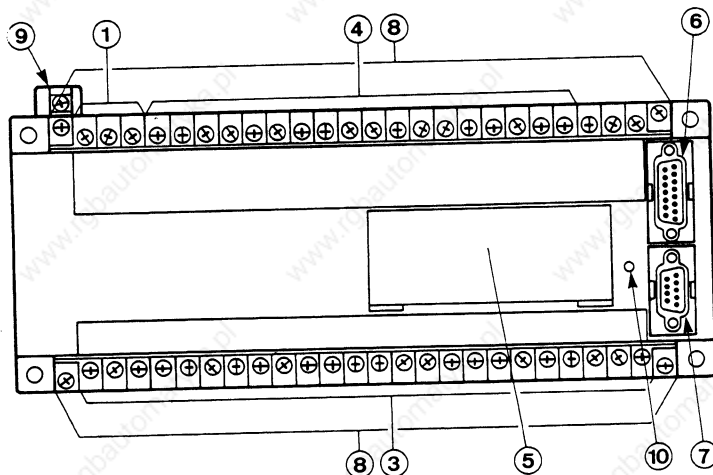


1 Planning the Installation

1.3 Discrete I/O Extension Modules

Extension modules - 8 discrete inputs or 6 discrete outputs

TSX DEF 812 - TSX DEF 804 input modules

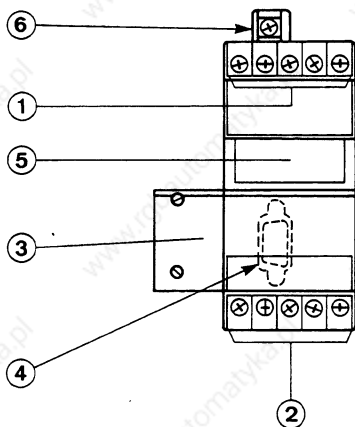

These modules comprise:

- 8 isolated 24VDC inputs ① and ② with a front panel status display ⑤,

| Modules | Isolated inputs | |
|-------------|-----------------|--------|
| | 24VDC | 110VAC |
| TSX DEF 812 | 8 | — |
| TSX DEF 804 | — | 8 |


- a 9-pin I/O bus input connector and its cable ③ to connect to the previous module,
- a 9-pin I/O bus output connector and its cable ④ to connect to the next module,
- a ground connector ⑥,

Maximum extension configurations:

- 2 extension modules on a TSX 17-10 or TSX 17-20 using PL7-1 language,
- 3 extension modules on a TSX 17-20 using PL7-2 language.

Refer to the compatibility rules on page 28.

TSX DSF 635 - TSX DSF 612 - TSX DSF 604 Output modules

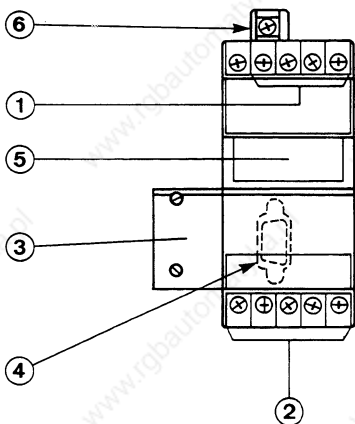

These modules comprise:

- 6 relay outputs ① and ② with a front panel status display ⑤,

| Modules | Isolated outputs with | | |
|-------------|-----------------------|---------------------------------------|---|
| | Relays | Transistors, Triacs (protected 0.35A) | |
| TSX DSF 635 | 6 | — | — |
| TSX DSF 612 | — | 6 | — |
| TSX DSF 604 | — | — | 6 |

- a 9-pin I/O bus input connector and its cable ③ to connect to the previous module,
- a 9-pin I/O bus output connector and its cable ④ to connect to the next module,
- a ground connector ⑥,

Maximum extension configurations:

- 2 extension modules on a TSX 17-10 or TSX 17-20 using PL7-1,
- 3 extension modules on a TSX 17-20 using PL7-2 language.

Refer to the compatibility rules on page 28.

1 Planning the Installation

1.4 Mains Power Break/Return

Consequences of a Mains Break

The effect of a mains power break/return on TSX 17 PLCs is described in the PL7-1 Summary (TSX D12011E) and PL7-2 Summary (TSX D12002E) manuals. The table below summarizes the consequences of a power break/return depending on:

- whether or not the processor monitors the sensor power supply,
- the duration of the power break. If the duration of the power break is less than the autonomy of the power supply module, the PLC will continue to execute its program normally and to acquire inputs and update outputs.

Depending on the type of power break/return, even if the context is coherent, the user should for application safety reasons, ensure that the processor has not received any wrong inputs caused by the power break. This situation can occur when the processor is still running on its own autonomy while power supply to sensors has been lost. The table below summarizes the various situations:

| Basic PLC type | Sensor supply | PLC supply autonomy | Hot restart with input state errors |
|--|---|--|--|
| Type 1 24 VDC inputs, 110/240 VAC mains | Built-in and monitored by CPU bit Sx,1 | 10 to 50 ms at 110 V rated 20 to 50 ms at 220 V rated | No danger of input errors: sensor supply exceeds autonomy. |
| Type 2 24 VDC inputs, 24 VDC supply | Not built-in, but monitored by CPU bit Sx,1 | 10 to 35 ms at 24 V rated | Danger of errors occurring on loss of 24 VDC supply. |
| Type 3 110 VAC inputs, 110/220 VAC mains | Not built-in and not monitored by the CPU | 35 to 80 ms at 110 V rated 50 to 75 ms at 220 V rated | Danger of error occurring on loss of 110 VAC supply. |

Hot Restart with the Danger of Input Errors (Types 2 and 3)

On hot restart, the danger of input errors (input at 0 instead of 1 for example), is compatible with the level of safety required by the application. To avoid this danger, the PLC must be initialized at the start of its program by setting the cold restart bit SY00 to 1 and the output reset bit SY09 to 1. Refer to the examples on the next page.

Programming hint:

To limit the danger of input errors after a hot restart, ensure that the automated system is only triggered by inputs at 1 (on rising edge).

1 Planning the Installation


Mains Power Break/Return (Cont'd)

PL7-1 Hot Restart Programming (for Types 2 and 3)

S000 L SY01 if SY01 (hot restart), then set:
S001 S SY00 • SY00 to 1 to perform a cold restart,
S002 = SY09 • SY09 to hold the outputs at 0.

Bits SY00 and SY09 are reset to 0 by the system at the end of the next cycle.

PL7-2 Hot Restart Programming (for Types 2 and 3)

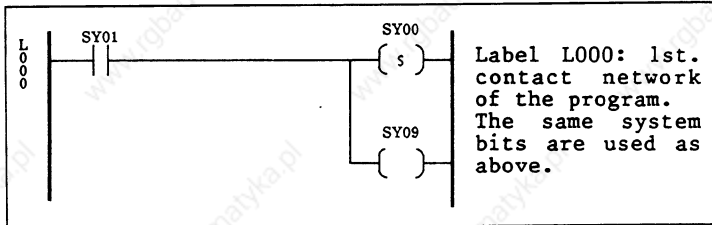

Consequences of a Cold Restart

- All internal bits and I/O bits are set to 0,
- Resetting to 0 of the current values of functions (PL7-1) and function blocks Ti,V, Mi,V, Ci,V etc. (PL7-2),
- Loss of function block values that had been modified by the terminal of the program. These blocks (Ti,P, Mi,P, Ci,P TXTi,x, etc.) return to their preset value defined in the configuration and (in PL7-2), internal words Wi and active time counters Xi,V and Di,V are reset to 0,
- Reinitialization of registers, step counters and drum controllers,
- Reinitialization the Grafset (activation of initial steps),
- Cancellation of forced bits and breakpoints,
- Execution restarts at the start of the scan cycle (inputs, program, outputs) and SY00 is reset to 0 by the system.

Constant words CWi and real-time clock parameters are not changed.

Important: Industrial safety standards require that the restarting of the system after a mains power break, must be manually initiated by the operator. By slaving the power supplies as described previously, these standards can be met.

A cold restart usually requires returning the physical part of the application to its initial position (either manually or automatically). This procedure is not detailed in this manual.

1 Planning the Installation

1.5 Catalog Information (Accessories)

Intelligent Modules for TSX 17 Micro-PLCs

| Ref. No. | Purpose | Manual | Language |
|------------------------------------|---|----------------------------|--------------------|
| TSX DTF 400 | 4 analog timers | TSX D12010E TSX D12005E | (PL7-1) (PL7-2) |
| TSX AEG 4110 | 4 ± 10 V analog inputs | TSX D12005E | (PL7-2) |
| TSX AEG 4111 | 4 4-20 mA analog inputs | TSX D12005E | (PL7-2) |
| TSX ASG 2000 | 2 ± 10 V analog outputs | TSX D12005E | (PL7-2) |
| TSX ASG 2001 | 2 4-20 mA analog outputs | TSX D12005E | (PL7-2) |
| TSX 17 ACC5 | Uni-Telway (slave) adapter | TSX D24006E | (PL7-2) |
| TSX SCG 116 (under development) | Uni-Telway (master/ slave) module | TSX D24007E | (PL7-2) |
| TSX SCG 113 (under development) | 1 channel, asynchronous serial communication module | TSX D23009E | (PL7-2) |

PL7-2 Software cartridge

| Ref. No. | Function |
|------------------|---|
| TSX P17 20 FA(*) | Enables the programming of TSX 17-20 PLCs in PL7-2 programming language |
| TSX P17 20 FB(*) | Identical to TSX P17 20 FA with Clock/Calendar function |

Memory storage

| Ref. No. | Type | Storage |
|----------------------|---|---|
| TSX MC70 E38 | 8K byte EEPROM (1K instructions in PL7-1) | User program |
| TSX MC70 E324 | 24K byte EEPROM (3K instructions in PL7-1) | User program |
| TSX MC70 E28 | 8K byte EEPROM (1K instructions in PL7-1) | User program |
| TSX MC70 E224 (*) | 24K byte EEPROM (3K instructions in PL7-1) | User program |
| TSX 17 ACC1 | Lithium battery 1 year service life(**) | User program, real-time clock/calendar |

Cables and Accessories

| Ref. No. | Type | Length |
|----------------|-------------------------------|------------|
| TSX CBB 003 | Connection to DMF.. extension | 0.32 meter |
| TSX CBB 009 | Connection to DMF.. extension | 0.90 meter |
| TSX CBB 016 | Connection to DMF.. extension | 1.60 meter |
| TSX CCB 020(*) | Fast counter connection cable | 2 meter |
| TSX 17 ACC10 | End of line adapter | |


(*) For TSX 17-20 PLCs only,

(**) 2 year service life if the surrounding temperature does not exceed 40 degrees C.

1 Planning the Installation

1.6 Specific I/O

Input/Output: Run/Stop - Alarm



A feature of the TSX 17 basic PLC allows input I0,00 and output O0,00 to each be assigned a specific function.

Run/Stop input: I0,00

Normal (nor): Operates in the same way as all other basic PLC discrete inputs.

Run/Stop (R/S):

- at 1 this input sets the PLC to Run,
- at 0 this input sets the PLC to Stop.

The actual Run/Stop input on the PLC has priority over a Run/Stop from a connected terminal.

Alarm output: O0,00

Normal (nor): Operates in the same way as all other basic PLC discrete inputs.

Alarm:


- at 1 if the PLC is Running with no faults,
- at 0 if the PLC is Stopped or Running but a fault is present.

Output O0,00 is used for safety systems that are external to the PLC. It can be used to cut-off the power to PLC outputs (refer to Sub-section 3.1).

Configuration of the specific I/O

Input I0,00 and output O0,00 are configured by default to normal mode. These I/O can be configured separately and respectively for Run/Stop and Safety modes using the terminal (in Configuration mode).


1.7 PL7-2 Software Cartridges



These cartridges can only be used in TSX 17-20 micro-PLCs and are required for PL7-2 language programming.


The user has a choice of two cartridges:

TSX P17 20 FA



PL7-2 language only

TSX P17 20 FB



PL7-2 language
with Clock/Calendar function

Inserting the cartridge

Cartridges should only be inserted when the PLC is powered-down.


Remove the factory fitted slot cover and insert the cartridge, pressing it firmly home and close the removal tab/cover.

1 Planning the Installation


1.8 Saving Programs and Data

If a power break occurs, the contents of the RAM memory of the micro-PLC (program, data and clock/calendar information) is retained for at least 1 hour. There are three ways of saving this data for longer periods: EEPROM and EPROM memory cartridges and a lithium battery.

EEPROM memory cartridges



| | | |
|----------------------|---------------------------|-----------|
| Ref. No.: | TSX MC70 E38 | 8K bytes |
| | TSX MC70 E324 | 24K bytes |
| Data storage life: | Permanent | |
| Type of data stored: | Program and configuration | |




Installing the cartridge

Cartridges should only be inserted when the PLC is powered-down.

Remove the factory fitted slot cover and insert the cartridge, pressing it firmly home and closing the removal tab/cover.

• Cartridge description:

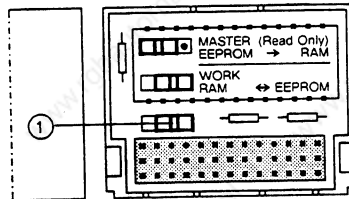

The user can select the required mode of operation by setting a two position micro switch ①:


• Cartridge Write/Read

Set the micro switch ① to the Work position for use when debugging the program and writing to the cartridge.

• Cartridge Read Only

Set the micro switch ① to the Master (Read Only) position to use a definitive stored program.

• Write/Read mode:

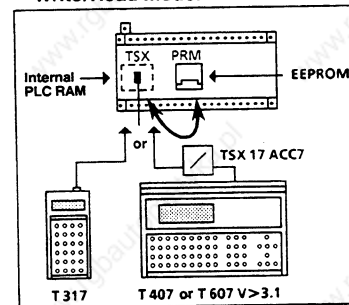

The transfer from the PLC RAM to EEPROM or from EEPROM to PLC RAM always takes place with the cartridge fitted in the PLC and the micro switch ① set to the Work position.

The transfer execution command is sent from a terminal in Transfer mode.

• Using the cartridge to store a Program

Once the program has been transferred to the cartridge, move the micro switch ① left to the Master position.


In this position, whenever a power return occurs, the content of the memory cartridge is automatically transferred to the RAM memory of the PLC, if the content of the PLC RAM is different from the EEPROM.

Note: The EEPROM memory comprises the configuration and the user program. Data is always stored in the RAM memory of the PLC.


1 Planning the Installation

Saving Programs and Data (Cont'd)

EEPROM memory cartridges



| | | |
|----------------------|---------------------------|-----------|
| Ref. No.: | TSX MC70 E38 | 8K bytes |
| | TSX MC70 E324 | 24K bytes |
| Data storage life: | Permanent | |
| Type of data stored: | Program and configuration | |




Installing the cartridge

Cartridges should only be inserted when the PLC is powered-down.


Remove the factory fitted slot cover and insert the cartridge, pressing it firmly home and closing the removal tab/cover.

Writing to the EPROM cartridge:

In PL7-1 language

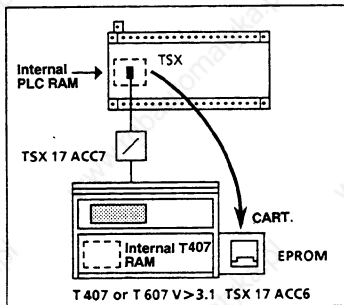

In PL7-2 language

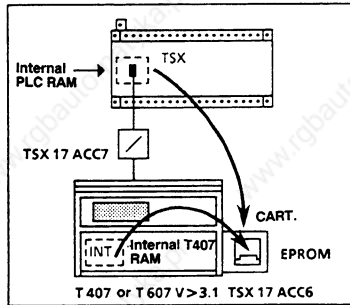


Transfer from the PLC RAM memory to the EPROM is always performed with the cartridge fitted in the TSX 17 ACC6 adaptor and controlled by the TSX T407 terminal in Transfer mode.


Reading from the EPROM cartridge:

With the cartridge fitted in the TSX 17 ACC6 adaptor and controlled by a terminal in Transfer mode.

PL7-1 language

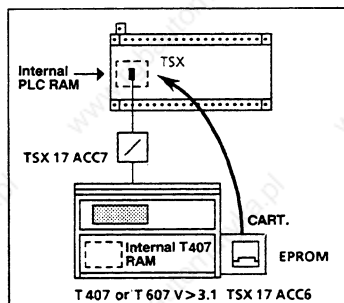

PL7-2 language

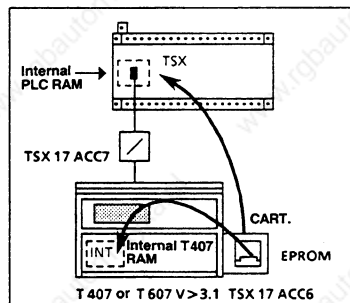


1 Planning the Installation


Saving Programs and Data (Cont'd)

With the cartridge fitted in the PLC, controlled by terminal in Transfer mode.

PL7-1 language

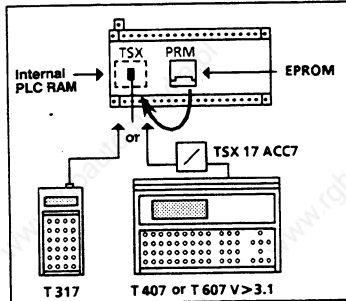

PL7-2 language

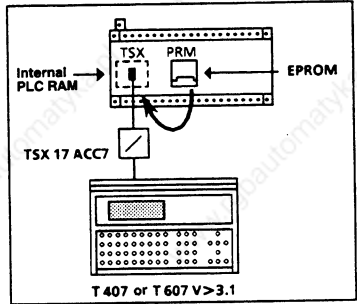


Reading programs stored in the cartridge:


Each time the PLC is powered-up (or on power return), the content of the memory cartridge is automatically transferred to the RAM memory of the PLC, if the content of the two memories are different.

- Note:**
- The EPROM memory is used to store the configuration and the user program. Data is always stored in the RAM memory of the PLC.
 - An EPROM memory cartridge is erased using a TSX EPE1/EPE2 UV cartridge eraser.

Lithium battery




Ref. No.: TSX 17 ACC1
 Data storage life: 1 year(*)
 Type of data stored: Program, data and clock/calendar information.



(*) The battery life can be longer if the operating temperature Θ_A is less than 40 deg. C (refer to the definition of Θ_A on Page 6/1).

Installing the battery

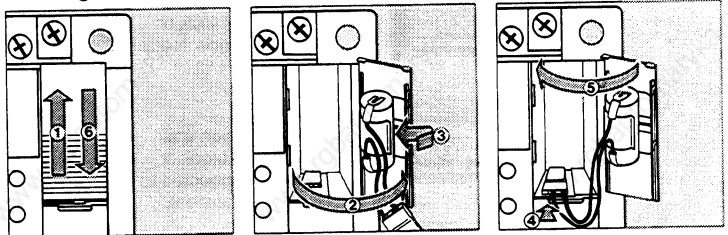


- 1 Release the cover
- 2 Remove the cover
- 3 Fit the battery
- 4 Plug-in the battery
- 5 Re-install the cover
- 6 Lock the cover

1 Planning the Installation

1.9 I/O Addressing

I/O addressing


- Addressing a discrete input or output:

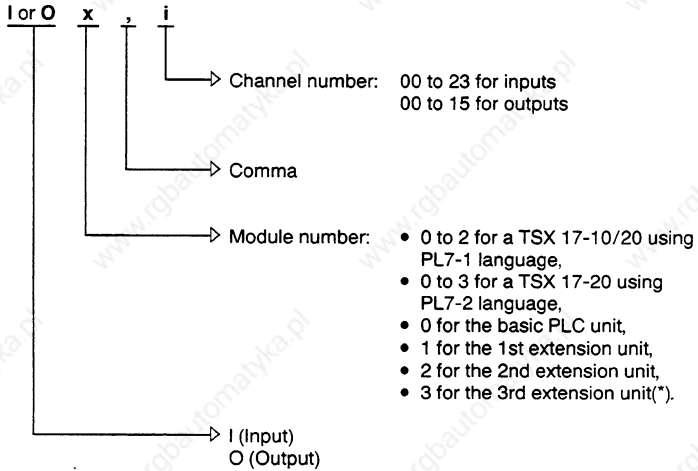

- Addressing the event triggered inputs IO,24 and IO,25, available on TSX 17-20.

Module identification in a TSX 17 configuration


Configuration examples:

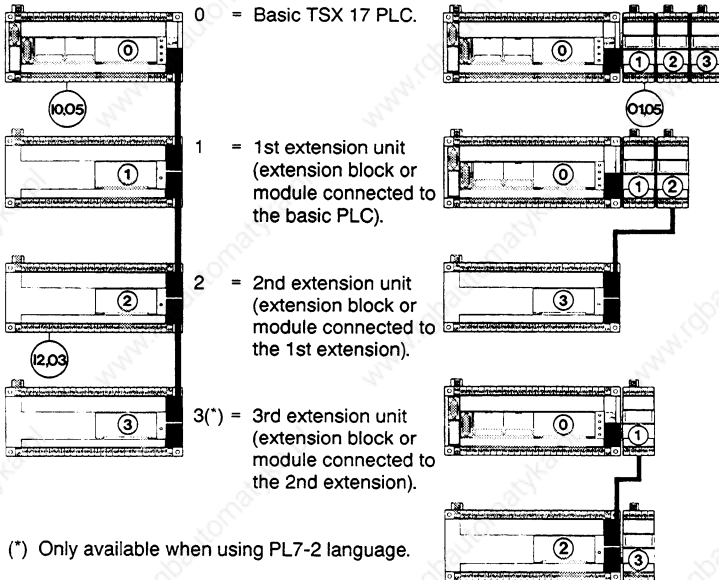


2 Mounting

2.1 Building a Configuration


Basic rules



- The basic micro-PLCs can be expanded with:
TSX 17-10/20, PL7-1 language: 1 or 2 discrete I/O extension blocks or modules,
- TSX 17-20, PL7-2 language: 1, 2 or 3 discrete I/O extension blocks or discrete I/O and analog modules and 1 Uni-Telway module.



Starting with the basic micro-PLC (address 0), discrete I/O and analog extension blocks or modules can be installed in any order.



- Discrete I/O extension blocks: An extension block (address n) is connected to the preceding block or module (address n-1) by a connector cable selected for the installation.

Three different cables are available:

- TSX CBB 003: length 0.32 meters ("x" on Pages 26 and 27),
- TSX CBB 009: length 0.90 meters ("y" on Pages 26 and 27),
- TSX CBB 016: length 1.60 meters ("w" on Page 27).

Caution: The maximum length of the bus extension depends on the number of extensions to connect (refer to the table below for the cables to use).

Extension cables that can be used in a configuration

| With 1 ext. block | With 2 ext. blocks | With 3 ext. blocks |
|-------------------|--------------------|--------------------------|
| 0.32 m | 0.32 m + 0.32 m | 0.32 m + 0.32 m + 0.32 m |
| 0.90 m | 0.32 m + 0.90 m | 0.32 m + 0.32 m + 0.90 m |
| 1.60 m | 0.32 m + 1.60 m | 0.32 m + 0.32 m + 1.60 m |
| | 0.90 m + 0.90 m | 0.32 m + 0.90 m + 0.90 m |



- **Discrete I/O modules:** The extension module is connected to the preceding block or module by a built-in cable. Therefore, additional modules are always located to the right of the preceding device,




- **Analog extension and analog timer modules:** These are installed in the same way as discrete I/O modules.



- **Uni-Telway adapter module:** This adapter connects to the programming port of the PLC by a 0.90 meter cable (supplied with the adapter). It can be mounted in any position in relation to the basic PLC.

2 Mounting

Building a Configuration (Cont'd)



- End of line adapter for extension blocks or modules.

The last extension block or module must be fitted with an end of line adapter on the connector located at the lower right of the front panel.


The TSX 17 ACC 10 end of line adapter is supplied separately.

All cables (except for the terminal cables) should only be connected or disconnected with the PLC powered-down.


The male connectors on the extension cables and the end of line adapter must be attached to the female connectors on the TSX 17 modules using their retaining screws.

2.2 Configuration Examples


Example 1: TSX 17-10



Example 2: TSX 17-20 - PL7-2

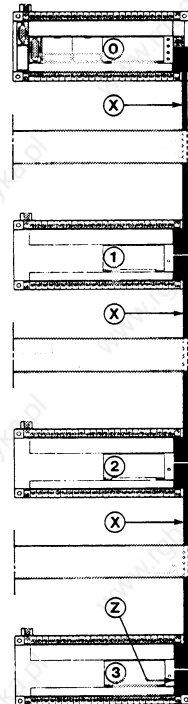


Example 3: TSX 17-10

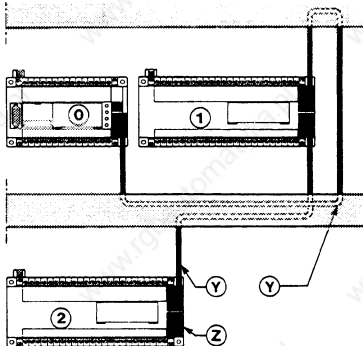


2 Mounting

Configuration Examples (Cont'd)


Example 4: TSX 17-20 - PL7-2

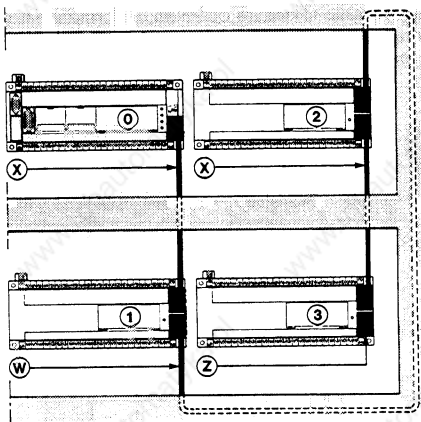


Example 5: TSX 17-20 - PL7-2

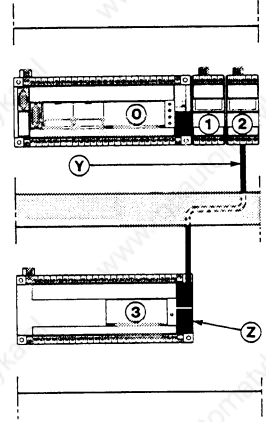

Example 6: TSX 17-20 - PL7-2



Example 7: TSX 17-20 - PL7-2



x = TSX CBB 003 cable, length 0.32 meters,

y = TSX CBB 009 cable, length 0.90 meters,

w = TSX CBB 016 cable, length 1.60 meters,

z = TSX 17 ACC 10 end of line adapter, supplied separately,

2 Mounting

2.3 Basic PLC/Extension Compatibility

The TSX 17 compatibility table below shows which units and modules can be used together to build complete configurations. All configurations used must follow the guidelines given in the table to ensure optimum performance from all operational features. In addition, this ensures that isolation standards are met and power supply load levels not exceeded.

| Basic micro-PLC | Language | Max. no. of extensions (1) | Discrete I/O ext. blocks | | | Discrete and analog I/O ext. modules | | | | | | UNI-TEL-WAY | |
|------------------------------|----------|----------------------------|--------------------------|-----|-----|--------------------------------------|-----------------|-------|---------------|----------|-------|-------------|------|
| | | | DMF | | | DEF 804 812 | DSF 604 612 635 | | DTF 400. 411. | AEG 200. | ASG | | ACC5 |
| | | | 344A 342A | 400 | 401 | | | | | | | | |
| TSX 171 2028 TSX 171 3428 | PL7-1 | 2 | X | | X | X | X | X | X | | | | |
| TSX 171 2002 | PL7-1 | 2 | X | X | X | X | X | | X | | | | |
| TSX 171 4002 | PL7-1 | 2 | X | X | X | X | X | | X | | | | |
| TSX 172 2028 TSX 172 2044 | PL7-1 | 2 | X | | X | X | X | X | X | | | | |
| | PL7-2 | 3 | X | | X | X | X | X | X | X | X (4) | X (3) | |
| TSX 172 2012 | PL7-1 | 2 | X | | X | X | X | X | X | | | | |
| | PL7-2 | 3 | X | | X | X | X | X | X | X | X | X (3) | |
| TSX 172 3428 TSX 172 3444 | PL7-1 | 2 | X | | X | X | X | X | X | | | | |
| | PL7-2 | 3 | X | | X | X | X | X (2) | X | X | X (4) | X (3) | |
| TSX 172 4012 | PL7-1 | 2 | X | | X | X | X | X | X | | | | |
| | PL7-2 | 3 | X | | X | X | X | X | X | X | X | X (3) | |

- (1) Except for the TSX ACC 5 Uni-Telway communication module.
- (2) The maximum number of TSX DSF 635 modules is restricted to 2.
- (3) One module per basic PLC.
- (4) The 24VDC sensor supply from the basic PLC can only be used to by one extension module. If more than one extension module is installed, an external 24VDC power supply must be used.

can be used together



cannot be used together

2 Mounting



2.4 Dimensions

Basic PLCs

TSX 171 2028
TSX 171 2002

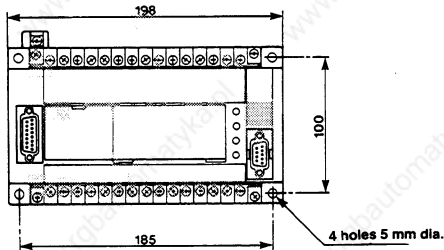



TSX 172 2028
TSX 172 2044
TSX 171 3428
TSX 172 3428
TSX 172 3444
TSX 172 2012
TSX 171 4002
TSX 172 4012

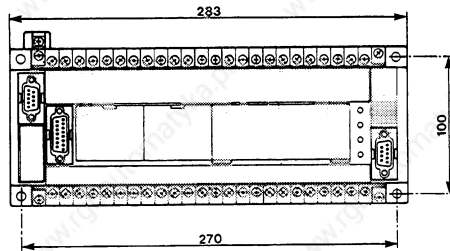



Extension blocks

TSX DMF 342A
TSX DMF 344A
TSX DMF 400
TSX DMF 401

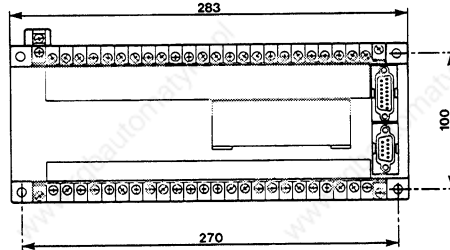

Extension modules

TSX DEF 804
TSX DEF 812
TSX DSF 604
TSX DSF 635
TSX DSF 612
TSX DTF 400
TSX AEG 41..
TSX ASG 20..
TSX 17 ACC5

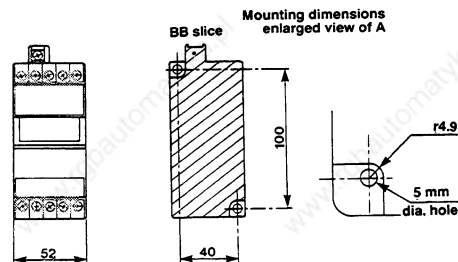


(*) 122 mm with connector (TSX CBB extension cable or TSX 17 ACC5 end of line adapter).

All dimensions given in mm.



2 Mounting

2.5 Mounting Considerations

On AM1-BA slotted plate



On 2000 mm zinc-chromed rails



Mounting by $\varnothing 4$ screws

- M4 clip-on nut AF1-EA4
M4x16 AF1-VA416 screws with captive washer

(*) Dimensions of the basic PLC or extension block with TSX CBB ... cable. Dimensions of TSX DEF, DSF, DTF, AEG, ASG, 17 ACC5 modules.


Mounting by $\varnothing 4$ screws

- ① 35 mm wide combined rail AM1-ED200 with nut AF1-CF34 and M4 x 16 screw AF1-VA416
- ② 35 mm wide omega rail AM1-DE200 with nut AF1-CG4 and M4 x 16 screw AF1-VA416
- ③ 32 mm asymmetrical rail DZ5-MB201 with nut DZ5-ME8 and M4 x 16 screw AF1-VA416.

Slot-in mounting.

Always ensure that the 4 mm dia. mounting screws are fitted with flat washers.

Mounting guidelines

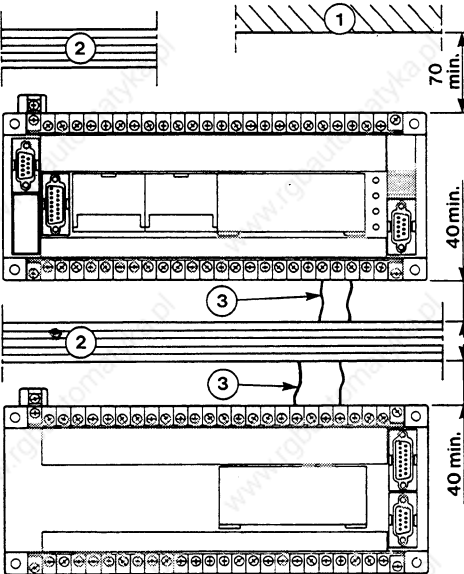

- ① Other device, enclosure or machine frame
- ② Cable duct or guide
- ③ Leave approx. 20 to 30 mm slack in the cabling to allow for inserting and removing the terminal block.

Important


On machines in which the PLC is subject to vibrations, make sure that the PLC is fixed by 4 screws to a support (machine frame or rigid plate) or is clipped onto a rail fixed at 300 mm centers maximum.

Avoid locating the extension blocks or modules above other heat generating devices (transformers, power supplies, contactors, etc.).

3 Wiring

3.1 Power Supplies

24VDC power supply

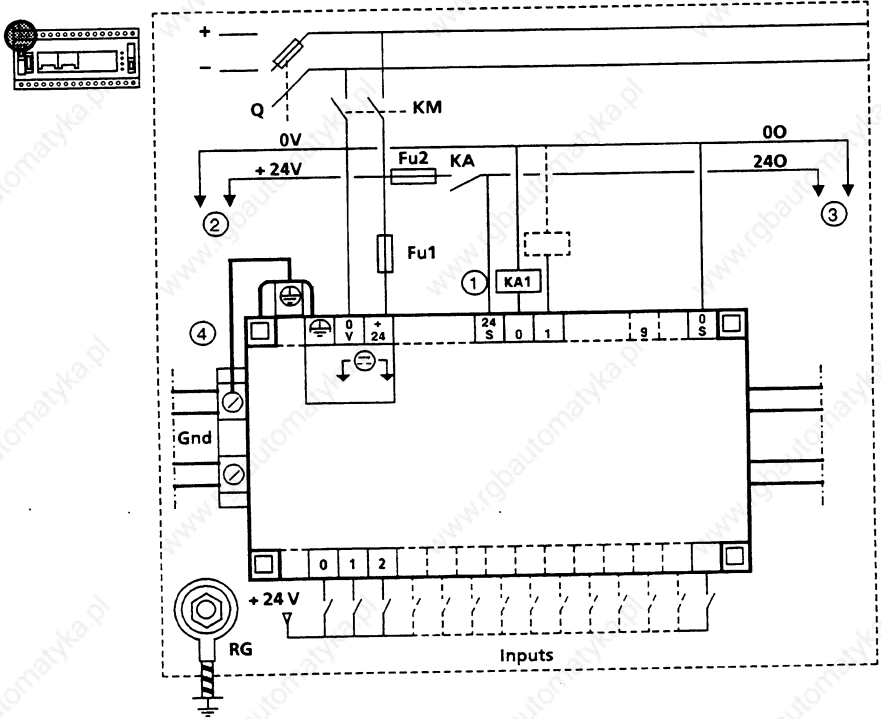

- Q** Master switch,
- KM** Line contactor or circuit breaker,
- KA** Power slaving contactor slaved to alarm output O0,00 by relay KA1,
- KA1** Relay connected to the Alarm output O0,00,
- Fu1** PLC power supply protection fuse (3A),
- Fu2** Output supply protection fuse,
- Gnd** Ground connection, type AB1-TB432/435 for mounting rails or type DZ3-FA3 for mounting plates (AM1-PA). This connection must be located as close as possible to the chassis ground on each module,
- RG** Reference ground to be connected to the factory ground,
- ① To discrete I/O and sensor DC power supply,
- ② To extension block and sensor DC power supply,
- ③ To switching device and DC extension control,
- ④ Ground wire for chassis ground, removable,

Important

- Connection to a power supply voltage other than that defined for the product cancels the guarantee.
- To avoid overvoltages due to power supplies external to the PLC, their terminals (0, +24V) should be equipped with a $2\text{ k}\Omega \geq 1\text{ W}$ (preload) resistor.

3 Wiring

Power Supplies (Cont'd)

Connecting the chassis ground

Each ground terminal (on the TSX 17, the transformers, etc.) must be connected separately and directly to the metal frame (AM1-PA mounting plate, mounting rails, etc.) through the ground connection (Gnd).

The reference ground should be connected to the earth ground of the factory or the site by a good quality copper braid of not less than 10mm² (AWG 7). This connection should be direct, permanent and continuous.


Power supply slaving

The internal and external power supplies should be slaved so as to operate in the following sequence:

1. Energize the power supplies to the PLC and the inputs (contact KM as shown on pages 31 and 32).
2. Energize the power supply to the outputs through output O0,00 and the alarm contact KA of the PLC, if the PLC is running and in Automatic mode.

In addition, industrial safety standards require that the restarting of the system after a mains power break or emergency stop, must be manually initiated by the operator.

The slaving diagram opposite complies with these safety standards.

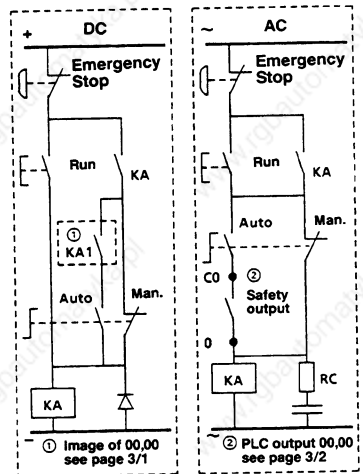

The Man/Auto switch allows the forcing of outputs when using a terminal connected to a PLC that is stopped (after SY8 is set to 0).

Power supply protection circuits

TSX Series 7 PLCs meet the electromagnetic interference standards defined in CEI 65A and NFC 63 850.

However, in industrial applications where high levels of interference are encountered, it may be necessary to fit an isolation transformer to the power supply (refer to sub-section 7.1).

Important


Inductive loads not controlled by the TSX 17, but using the same power supply must be fitted with a discharge diode (DC circuit) or RC circuit (AC circuit).

3 Wiring

3.2 24VDC Inputs, Relay Outputs


Basic TSX 17-10 PLC, TSX 171 2028

12 inputs, 24VDC isolated, 8 relay outputs

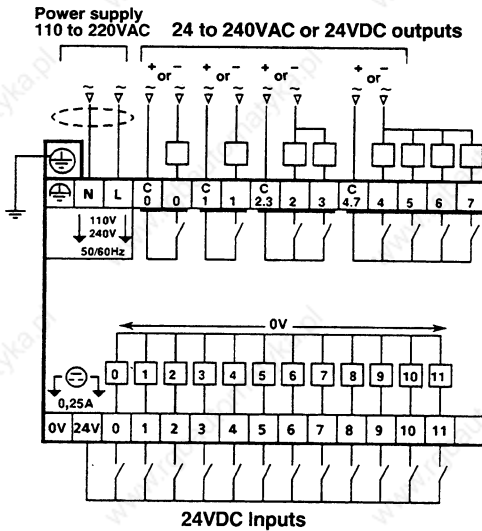

Basic TSX 17-20 PLC, TSX 172 2028

12 inputs, 24VDC isolated, 8 relay outputs

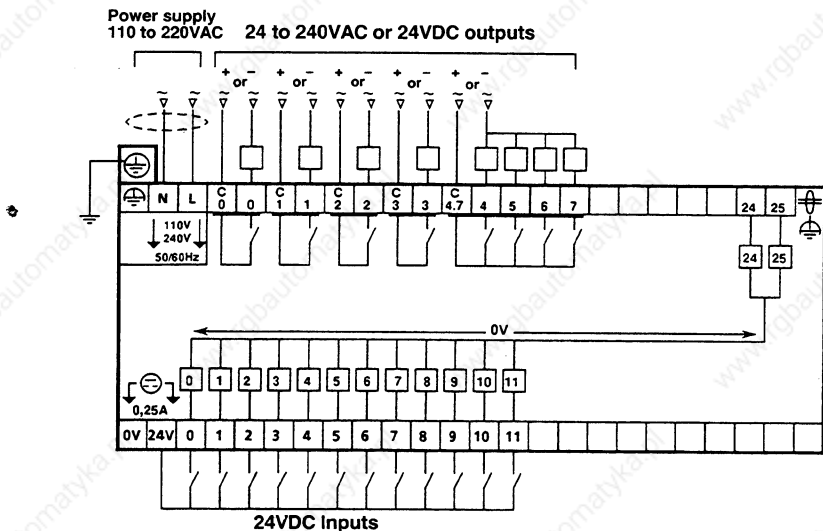


3 Wiring

24VDC Inputs, Relay Outputs (Cont'd)


Basic TSX 17-20 PLC, TSX 172 3428

22 inputs, 24VDC isolated, 12 relay outputs

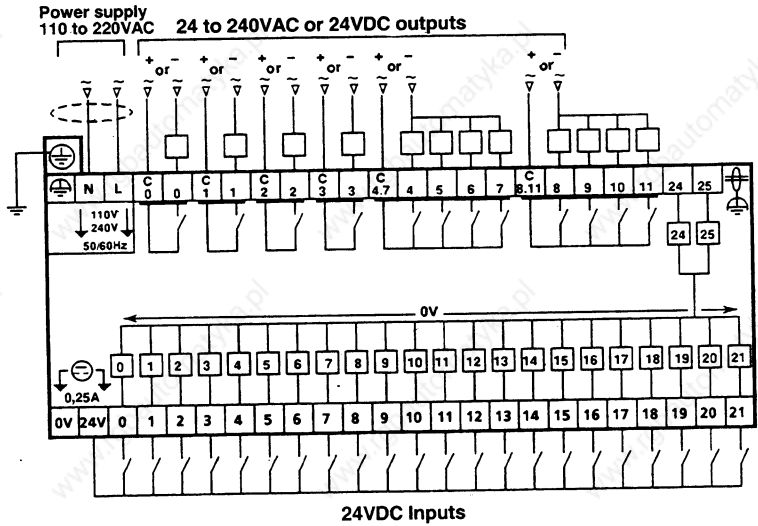

Basic TSX 17-10 PLC, TSX 171 3428
TSX DMF 342A Extension block

22 inputs, 24VDC isolated, 12 relay outputs

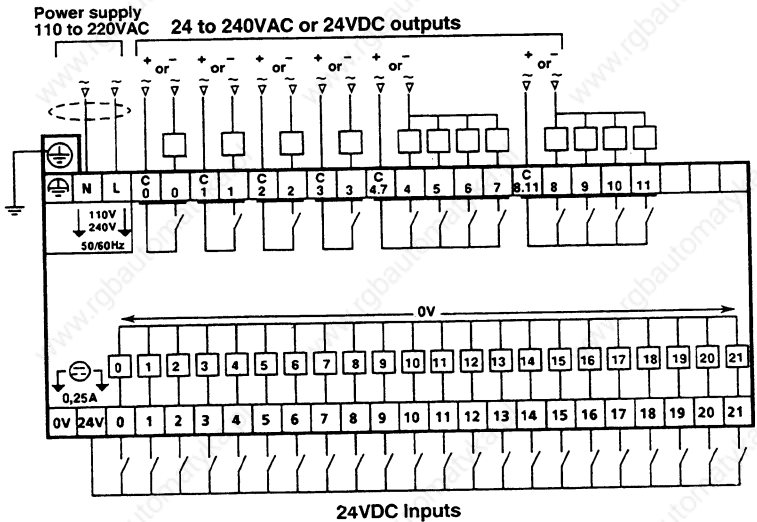


3 Wiring

3.3 110VAC Inputs, Relay Outputs


Basic TSX 17-20 PLC, TSX 172 2044

12 inputs, 110VAC isolated, 8 relay outputs

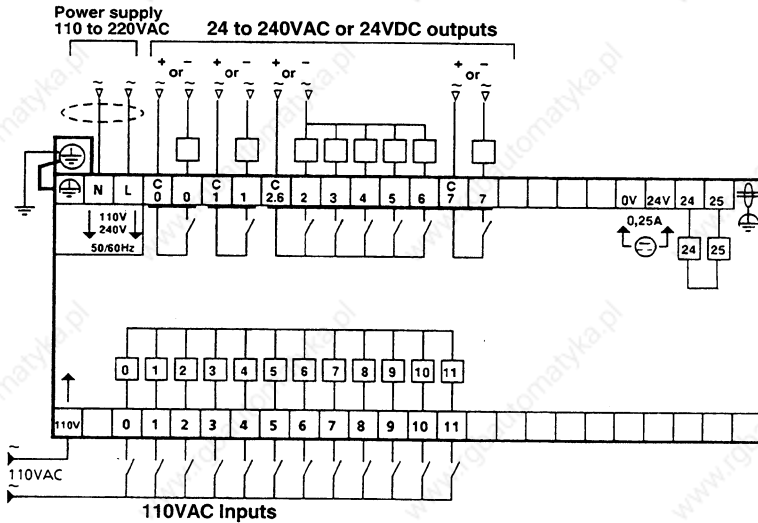

Basic TSX 17-20 PLC, TSX 172 3444

22 inputs, 110VAC isolated, 12 relay outputs

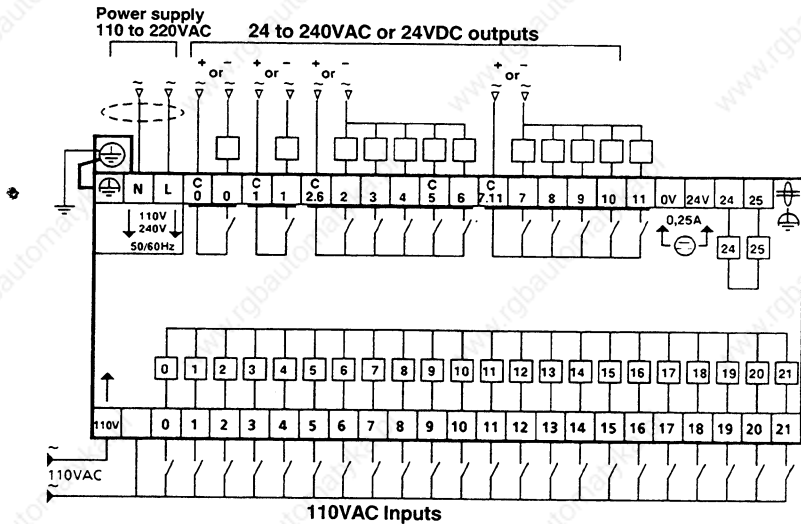


3 Wiring

110VAC Inputs, Relay Outputs (Cont'd)

TSX DMF 344A Extension Block

22 inputs, 110VAC isolated, 12 relay outputs.

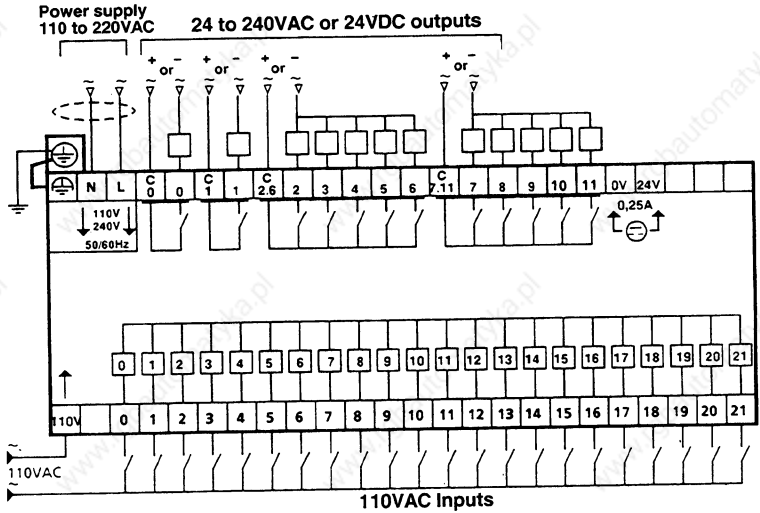


3 Wiring

3.4 24VDC Inputs, Transistor Outputs


Basic TSX 17-20 PLC, TSX 172 2012

12 isolated 24VDC inputs, 8 isolated and protected 0.35A transistor outputs.

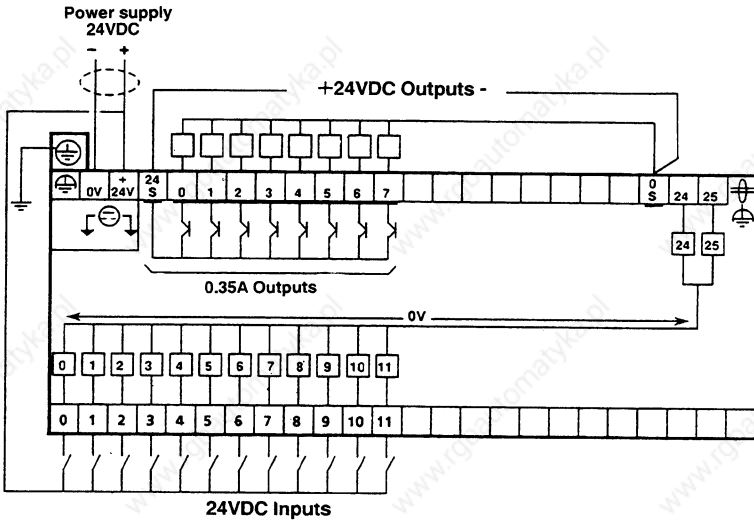

Basic TSX 17-20 PLC, TSX 172 4012

24 isolated 24VDC inputs, 16 isolated and protected 0.35A transistor outputs.

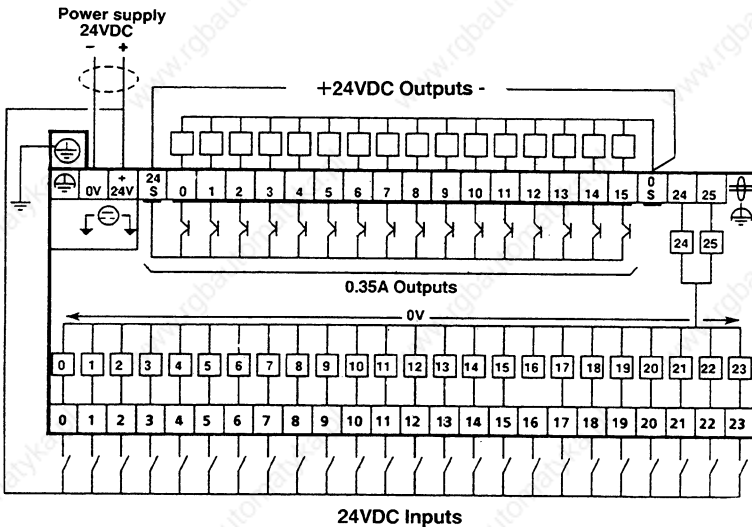


3 Wiring

24VDC Inputs, Transistor Outputs (Cont'd)

TSX DMF 401 Extension Block

24 isolated 24VDC inputs, 16 isolated and protected 0.35A transistor outputs.

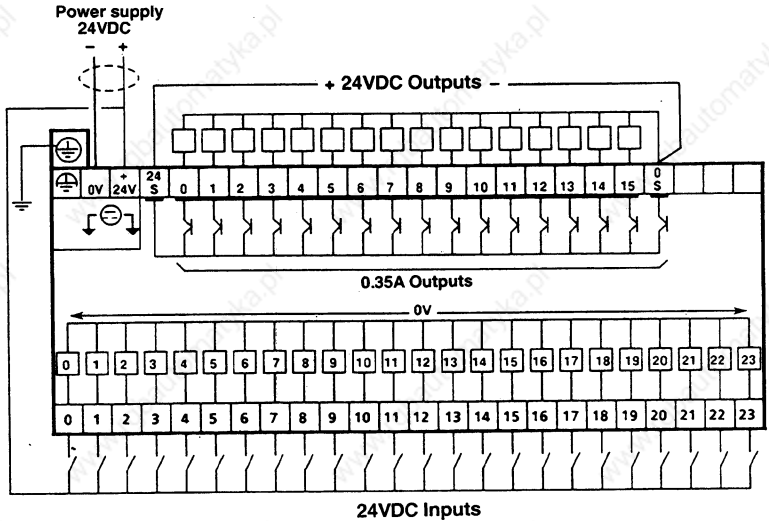


- The diagrams above and on the facing page show a 24VDC power supply that is separate from that of the PLC and the inputs although it is possible to use the same supply.
- Connecting the outputs in parallel. The two outputs can be connected in parallel (refer to the characteristics on Page 5/3).

3 Wiring

24VDC Inputs, Transistor Outputs (Cont'd)


Basic TSX 17-10 PLC, TSX 171 2002

12 inputs, 24VDC not isolated, 8 outputs, 1 and 2A, not isolated, not protected.

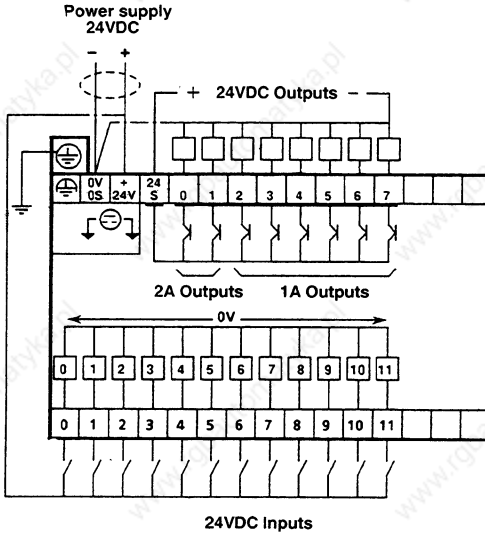

Basic TSX 17-10 PLC, TSX 171 4002

24 Inputs, 24VDC not isolated, 16 Outputs 1 and 2A not isolated and not protected.

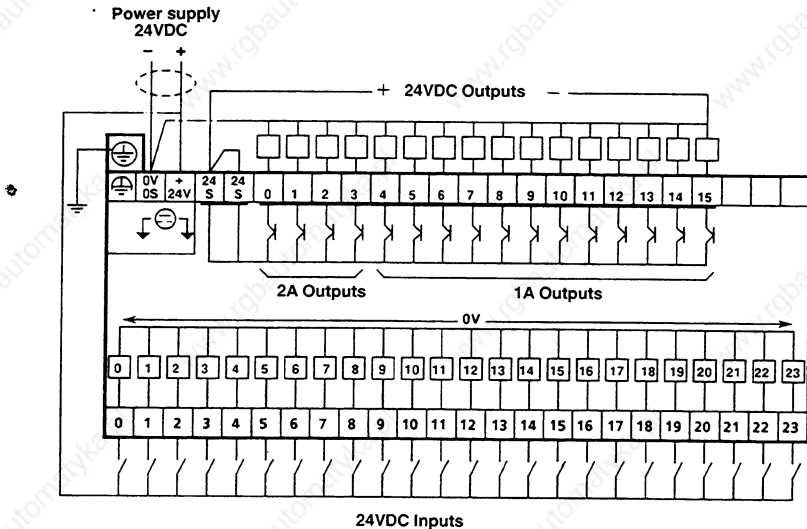


3 Wiring

24VDC Inputs, Transistor Outputs (Cont'd)

TSX DMF 400 Extension block

24 Inputs, 24VDC not isolated, 16 Outputs 1 and 2A not isolated and not protected.

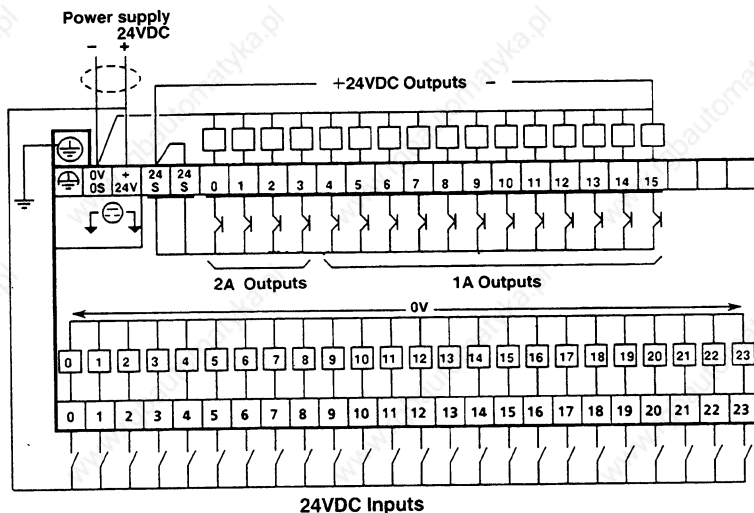

- Notes:**
- The diagrams above and on the facing page, show a 24VDC power supply that is separate from that of the PLC and the inputs although it is possible to use the same supply. In all cases the 0V lines must be common.
 - Distribution of the 1 and 2A outputs.

| | 2A Outputs | 1A Outputs |
|--------------|----------------|----------------|
| TSX 171 2002 | Points 0 and 1 | Points 2 to 7 |
| TSX 171 4002 | Points 0 to 3 | Points 4 to 15 |
| TSX DMF 400 | Points 0 to 3 | Points 4 to 15 |


- Connecting the outputs in parallel.
It is possible to connect the outputs in parallel (refer to the characteristics on Page 5/3).

3 Wiring


3.5 Extension Module I/O

Extension modules


TSX DEF 812
8 Isolated 24VDC inputs

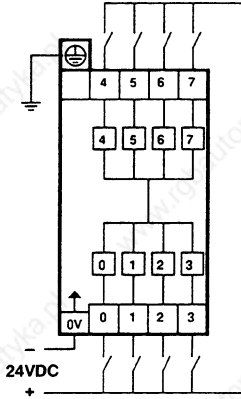


TSX DEF 804
8 Isolated 110VAC inputs

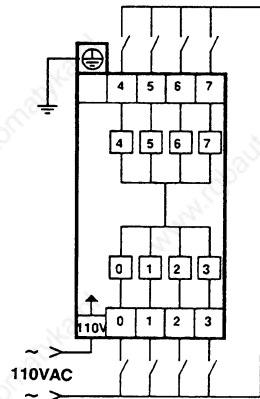


TSX DSF 635
6 relay outputs

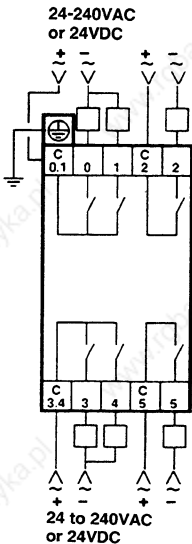

TSX DSF 612
6 Transistor outputs
0.35A isolated & protected

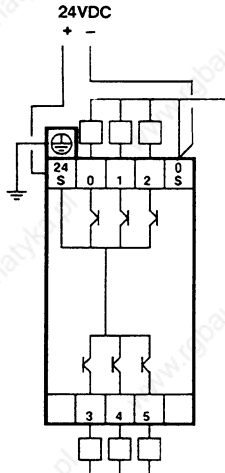


TSX DSF 604
6 Triac outputs

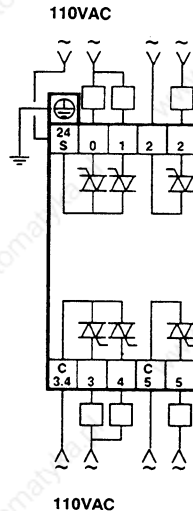

3 Wiring


3.6 2- and 3-Wire Detector Connection Examples

- For 24VDC inputs

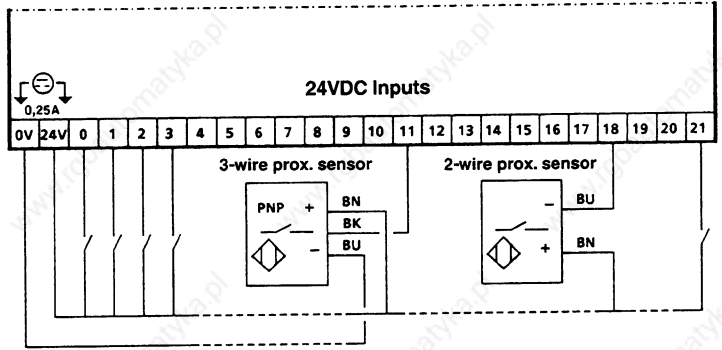

3-wire DC sensors: 24VDC, PNP output,
2-wire DC sensors: 24VDC rated supply with or without specified polarity.

- For 110VAC inputs

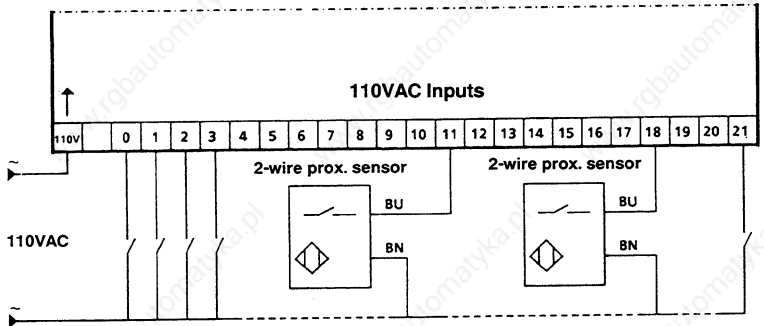

2-wire AC sensor: 110VAC rated supply.

3 Wiring

3.7 Event-Triggered Inputs

24VDC Event-Triggered inputs (TSX 17-20 only)

Basic PLCs


TSX 172 2028/2012

TSX 172 3428/4012

Basic PLCs

TSX 172 2044

TSX 172 3444

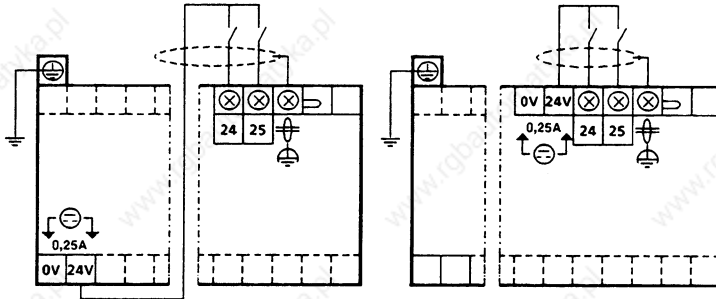

The fast response time of the event-triggered inputs I0,24 and I0,25, require the use of shielded cables for connecting these inputs.

The event-triggered inputs will accept 24VDC, 2- or 3-wire sensors (using the same wiring principles described on the previous page).

At the PLC end, the shielding should be connected to the connector provided on the PLC.

3 Wiring


3.8 Fast Counter

Fast counter (TSX17-20 only)


The fast counter has two separate channels that are both isolated. The selection of the operating voltage for each input is separate and can be different:

- counter input (5 or 24VDC),
- reset input (5 or 24VDC).

Example 1: Connecting a Telemecanique XCC-H.S.. encoder (counter) and a 3-wire PNP detector (used for reset).

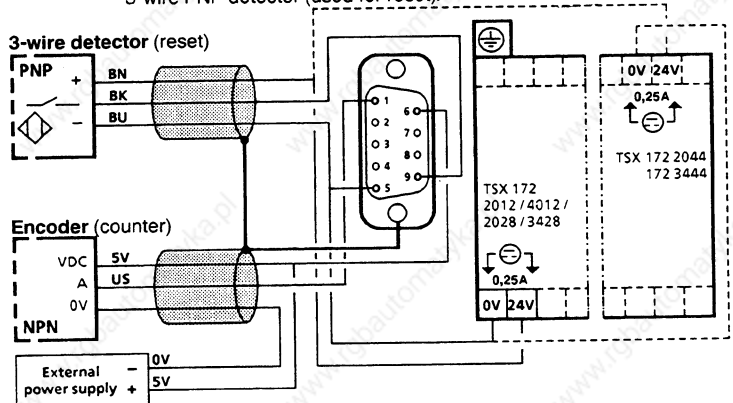

Example 2: Connecting a Telemecanique XCC-H.S.. encoder (counter) and a 3-wire PNP detector (used for reset).

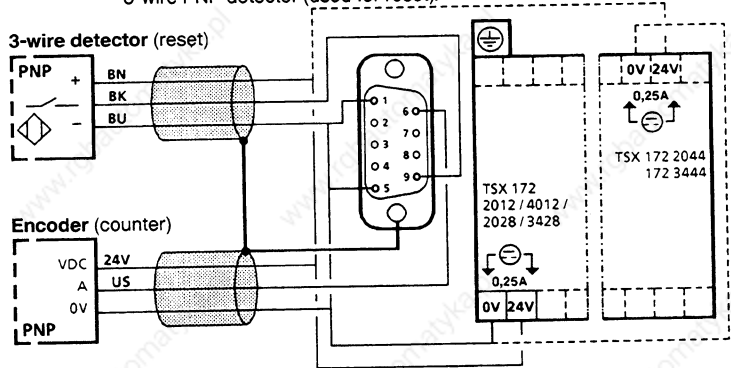

Connection is made to the top left (9-pin) female connector on the TSX 17-20. The connection is made using a TSX CCB 020 cable, length 2 meters, that is fitted with a (9-pin) male connector at one end, the other end can be fitted with a TSX CAC 04 (9-pin) connector that should be soldered on. The cable shielding is connected to the PLC ground through the ground connector of the PLC.

Connector pin-arrangement and wire color coding

| Input | pin | color | Input | pin | color |
|-------------|-----|-------|-----------|-----|--------|
| 0V counter | 1 | blue | 0V reset | 5 | yellow |
| 5V counter | 7 | black | 5V reset | 8 | orange |
| 24V counter | 6 | grey | 24V reset | 9 | white |
| | | | not used | | purple |

3 Wiring

3.9 Wiring the I/O

The TSX 17 PLC comprises built-in I/O protection circuits that ensure correct operation in harsh industrial environments.

However the following rules apply to ensure that the wiring meets the requirements for preserving this level of protection.

Discrete inputs

All multiple conductor cables that carry sensor data must also carry the common line for these signals.

Analog inputs

The analog inputs are carried by shielded twisted pair cables over a maximum length of 200 meters.

Discrete outputs

If a contact is added between a PLC output and a switching device coil, external protection should be provided on the terminals of the coil and the switching device:

- RC circuit for AC switching devices (Ref. No. LA9 D09980),
- discharge diode for DC switching devices.

Analog outputs

The analog outputs are carried by shielded twisted pair cables over a maximum length of 200 meters.

Cable routing

Outside the enclosure :

All cables to the I/O should be run in separate cable ducts away from high voltage cables. For long parallel runs, ensure that a separation of at least 100 mm is maintained between the ducts.

Inside the enclosure :

All power circuit cables (power supplies, power contacts, electrically operated valves, etc) should be kept separate from the input (sensor) and output (switching device) wires.

If possible ensure that input and output wiring is kept in separate cabling ducts.


Note: DC current signals and AC current signals should always be run through different cables.

Test

When testing a voltage on the terminal block connectors, always ensure that the screws are tightened down firmly (to ensure proper contact).

4 Setting into Service - Maintenance

4.1 Initial Power-up Procedure




The various built-in self-tests ensure continuous monitoring of the various functions of the TSX 17 PLC.

The results of these self-tests are displayed on the front panel of the PLC basic unit. Additional information can be gained by connecting a TSX T317 or TSX T407 terminal in Diagnostic mode.

The diagram below gives the procedure to be followed when the PLC is first powered-up (with blank RAM memory).



Before powering-up the PLC remove the protective cover from the PLC. This should always be in place during wiring operations.

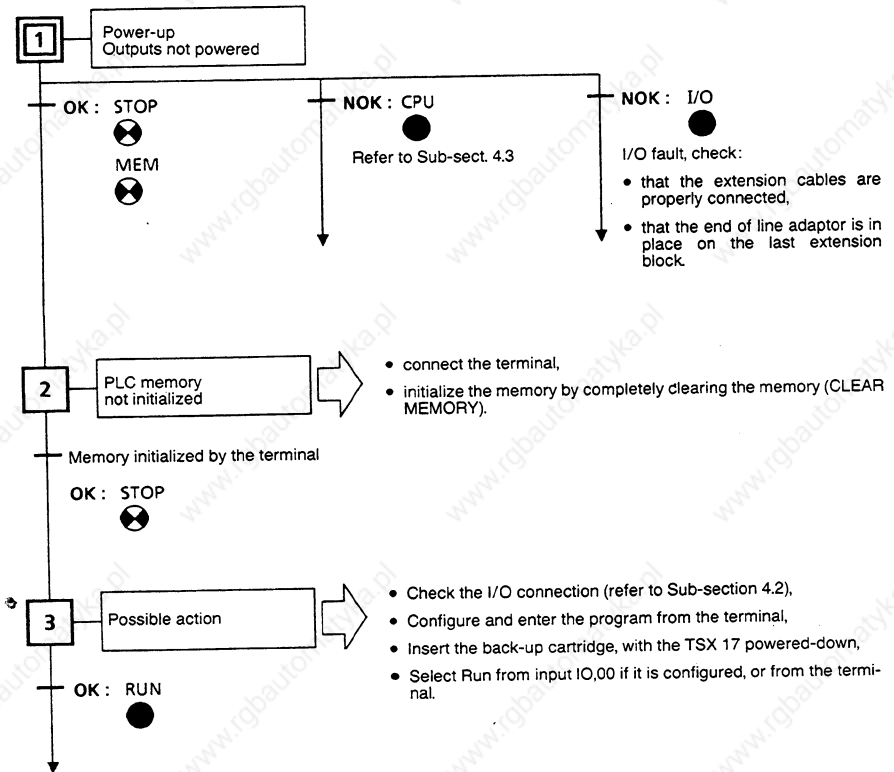

Note: The following applies to all steps

Description

BATT Battery failure or Battery not fitted



Indicator on,

Blinking indicator,

4 Setting into Service - Maintenance

4.2 Checking the I/O Connections

Principle


The I/O connection check is performed to ensure that:

- Data from sensors is accepted by the inputs and sent to the processor,
- Command instructions from the processor activate the outputs and are sent to the corresponding switching devices.

Caution: To avoid causing unnecessary and potentially dangerous machine motion during checking procedures, the following precautions should be taken:

- remove the motor drive power supply fuses,
- disconnect pneumatic and hydraulic supply lines.

Procedure













Follow the procedure described below:

- Perform the initial power-up procedure as described opposite (steps 1 and 2). Ensure that the I/O indicator is not lit.
- Leave the PLC in Stop,
- Select Adjust mode from the TSX T317 or TSX T407 terminal,
- Change the state of system bit SY08 (Alarm output): set this bit to 0,
- Checking the inputs:
On actuation of each sensor:
 - check that the corresponding input indicator on the front panel changes state,
 - using the terminal display, check that the corresponding input bit also changes state.
- Checking the outputs:
 - using the terminal, set each output bit first to 0 then to 1,
 - check that the corresponding output indicator on the front panel changes state,
- When the checks are complete:
 - cancel all forcing,
 - reset system bit SY08 to 1 (all outputs are set to 0).


Note: This entire procedure can be carried out in Run mode, if the PLC does not have an application program loaded. In this case SY08 can remain at 1 (state by default).

4 Setting into Service - Maintenance

4.3 Troubleshooting Using the Indicator Lights

| Basic PLC | Description | Probable cause and corrective action |
|--|---|---|
| RUN/STOP LED    | PLC power off PLC stopped PLC running | Status selected by setting IO,00 from the terminal or caused by a fault. Normal state |
| CPU/PROG LED    | Normal operation Triggers the watchdog (150ms), stops the PLC. Processor fault | Programming error caused by an upstream Jump command. Check and modify the program. Cartridge or PLC fault, replace the faulty component. |
| I/O/MEM LED    | Normal operation PLC memory not initialized: blank cartridge (first power-up) or back-up memory endurance exceeded. Input/Output fault(*) | <ul style="list-style-type: none"> • Check the condition of the battery, • Initialize the memory from the terminal by completely erasing the memory (CLEAR MEMORY, CLM). • Software configuration that does not correspond to the hardware configuration. • Extension cable incorrectly mounted or faulty, • No end of line adaptor fitted to the last extension, • No 24VDC supply to the sensors (or overload I > 250mA), • I/O circuit failure, replace the PLC. |
| BATT  | Battery not fitted or faulty. | |

Extension blocks and modules

| | | |
|---|--------------------|--|
| I/O  | I/O exchange fault | Refer to the 2nd and 3rd corrective actions listed for I/O faults. |
|---|--------------------|--|



Off



Blinking



On

(*) The terminal Diagnostics mode will give the cause of the fault. If the fault remains after corrective action has been taken, reset the PLC (selecting INIT from the terminal).

4 Setting into Service-Maintenance

Notes

5 Technical Characteristics

5.1 Power Supply Characteristics

| Power supply for basic PLCs and extensions blocks | Type | TSX 171 2028/3428 | TSX 171 2002 | TSX 172 2012 |
|---|------------|-------------------|--------------|-----------------|
| | | TSX 172 2028/2044 | TSX 171 4002 | TSX 172 4012 |
| | | TSX 172 3428/3444 | TSX DMF 400 | TSX DMF 401 |
| | | TSX DMF 342A/344A | | |
| Discrete inputs | | | | |
| Power supply voltage | rated | 110-240VAC | 24VDC | 24VDC |
| | limit | 96 to 284VAC | 19.2-30V (1) | 19.2-30V (1) |
| Frequency | rated | 50/60Hz | - | - |
| | limit | 47 to 63Hz | - | - |
| Power required | basic PLC | 42VA | 16W | 24W |
| | ext. block | 31VA | - | - |
| Protected sensor supply | | 24VDC/0.25A | - | - |
| Supply/ground isolation | | 1500V eff./50Hz | none | 1500V eff./50Hz |
| Meets CEI standard 65A | | yes | yes | yes |

5.2 Discrete Input Characteristics

| 24VDC Input characteristics. | Basic PLC units | | TSX 171 2028/3428 | |
|---|--|---|---|---|
| | | | TSX 171 2002 | TSX 172 2028/3428 |
| | | TSX 171 4002 | | TSX 172 2012/4012 |
| | | TSX DMF 400 | | TSX DMF 342A/401 |
| | | | | TSX DEF 812 |
| Positive logic | Type | not isolated | isolated | isolated |
| | Rated input values | <ul style="list-style-type: none"> voltage current sensor supply | 24VDC 7mA 19.2-30VDC (1) | 24VDC 7mA 19.2-30VDC (1) |
| Display of each input, PLC side | Limit input value | <ul style="list-style-type: none"> at 1 voltage current at 0 voltage | $\geq 11V$ $\geq 2.5mA$ for U=11V $\leq 5V$ | $\geq 11V$ $\geq 2.5mA$ for U=11V $\leq 5V$ |
| | Sensors commoned to the +24V for DC inputs | current | $\leq 1.4mA$ | $\leq 1.4mA$ |
| Input impedance | Response times | <ul style="list-style-type: none"> from state 0 to 1 from state 1 to 0 | 3.2 to 3.7Kohms 4.5 to 12ms 4.5 to 12ms | 3.2 to 3.7Kohms 4.5 to 12ms 4.5 to 12ms |
| | Power dissipation per point at state 1 | | 0.17W | 0.17W |
| External line | line resistance | $< 500ohms$ | $\leq 500ohms$ | $\leq 500ohms$ |
| | leakage resistance | $\geq 30Kohms$ | $\geq 30Kohms$ | $\geq 30Kohms$ |
| Isolation | between inputs and bus | none | $\geq 10Mohms$ at 500VDC | $\geq 10Mohms$ at 500VDC |
| | type | | optical coupler | optical coupler |
| Meets CEI standard 65A | | Class 1 | Class 1 | Class 2 |
| Compatible with 2- and 3-wire Telemecanique sensors | | yes | yes | yes |

(1) Including ripple

5 Technical Characteristics

Discrete Input Characteristics (Cont'd)

| 110VAC Input characteristics | Basic PLC units Extension blocks & modules | TSX 172 2044 TSX DMF 344A | TSX 172 3444 TSX DEF 804 | |
|---------------------------------|--|---|--|---------------------------------------|
| Display of each input, PLC side | Rated input values | 110VAC | | |
| | | • voltage | 110VAC | |
| | | • current | 15mA | |
| | | • frequency | 50/60Hz | |
| | | • sensor supply | 88VAC to 132VAC | |
| | Limit input values | • at 1 voltage | > 74V | |
| | | • current | > 6mA for U=74V | |
| | | • at 0 voltage | < 20V | |
| | | • current | < 4mA | |
| | | • Frequency | 47 to 67Hz | |
| | | Input impedance | 5.8 to 9.5Kohms | |
| | | Response times | • from state 0 to 1 • from state 1 to 0 | 33ms 50ms |
| | | Power dissipation per point at state 1 | 0.2W | |
| | | External line isolation | • line resistance • leakage resistance | < 1Kohms > 30Kohms |
| | | Isolation | • between inputs and bus • type | 1500Veff - 50/60Hz optical coupler |
| | Meets CEI standard 65A | Class 2 | | |
| | Compatible with 2- and 3-wire Telemecanique sensors | yes | | |

5.3 TSX 17-20 Event Triggered and Fast Counting Input Characteristics

| Inputs | Event trig. | Fast counting |
|---|--|---|
| Rated values | • voltage • current | 24VDC 15mA |
| Limit input values | • at 1 voltage • current • at 0 voltage • current | 24VDC 15mA 38mA |
| Response times | • from state 0 to 1 • from state 1 to 0 | 0.15 to 1ms 0.3 to 1ms |
| Isolation | • between inputs and bus • type | maximum allowable frequency 2KHz 2KHz |
| Meets CEI standard 65A | Class 2 | Class 2 |
| Compatible with 2 and 3-wire Telemecanique sensors | yes | yes |

The I/O characteristics are given for a 60% load factor (number of I/O simultaneously at 1 in relation to the total number of I/O).

5 Technical Characteristics

5.4 Discrete Output Characteristics

Transistor output characteristics

Basic PLC units

TSX 172 2012
TSX 171 2002 TSX 172 4012
TSX 171 4002 TSX DMF 401
TSX DMF 400 TSX DSF 612

Extension blocks
Extension modules


Positive logic
Display of each input, PLC side
Loads commoned to the - of the power supply

| Type of outputs | Transistors not protected | Transistors protected |
|--|---------------------------|------------------------------------|
| DC loads | | |
| • rated voltage | 24VDC | 24VDC |
| • rated current | 2A* 1A* | 0.32A (refer to the diagram below) |
| • rated current with 2 outputs in parallel | 3.2A 1.6A | 0.63A (refer to the diagram below) |
| • Tungsten filament indicator light | 10W | 8W |
| Limit values | | |
| • voltage (including peaks) | 19.2-30VDC | 19.2-30VDC |
| Leakage current at 0 | ≤ 1mA | ≤ 0.1mA |
| Leakage current at 1 for rated I | ≤ 0.5V | ≤ 1.3V |
| Response time (t) | | |
| • from state 0 to 1 | ≤ 100µs | ≤ 100µs |
| • from state 1 to 0 | ≤ 200µs | ≤ 500µs |
| isolation | | |
| • between outputs & bus | none | ≥ 10Mohm at 500VDC |
| • type | - | optical coupler |
| Built-in protection | | |
| • against shorting and overloading | none | thermal protection |
| • against inductive overvoltages | yes | yes |
| Compatible with TSX 17 24VDC inputs | yes | yes |
| Meets CEI standard 65A | yes | yes |

* Refer to Page 3/11 for the levels of the different outputs.

- (1) In order to provide short guaranteed response times for fast applications, some transistor outputs are equipped with diode and zener diode fast discharge circuits, these outputs are:
- outputs 0 and 1 of the TSX 172 2012/4012 and TSX DMF 401,
 - all outputs of the TSX 171 2002/4002 and TSX DMF 400.
- With these outputs, the drop-out time of an actuator solenoid is:
 $t = L/R$, with L expressed in Henrys and R in ohms.

Power level of the protected transistor outputs

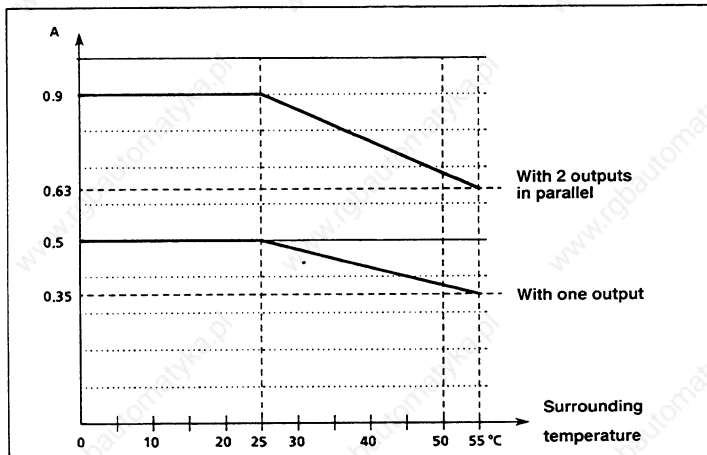

The I/O characteristics are given for a load rating of 60% (number of I/O at state 1 in relation to the total number of I/O).

5 Technical Characteristics

Discrete Output Characteristics (Cont'd)

| | | | | | | |
|----------------------------------|-------------------------------------|---|---|--|----------------------|------------------------|
| Relay output characteristics | Basic micro-PLCs | TSX 171 2028/3428, TSX 172 2028/2044, TSX 172 3428/3444 | | | | |
| | Extension blocks and modules | TSX DMF 342A, TSX DMF 344A, TSX DSF 635 | | | | |
| | Type of outputs | Relay | | | | |
| Display of each output, PLC side | AC loads | • voltage | 24 to 240VAC | 24V | 48V | 110/240V |
| | | • permissible power for AC11 duty (0.5Hz) | 9VA | 3x10 ⁶ ops.10x10 ⁶ ops.10x10 ⁶ ops. | | |
| | | | 25VA | 0.2x10 ⁶ ops. 10 ⁶ ops. | | 2x10 ⁶ ops. |
| | | 50VA | | | 10 ⁶ ops. | |
| 1 N/O contact per output | DC loads | • voltage | 24V | | | |
| | | • permissible power for DC11 duty(0.5Hz) | 10W | | | |
| | Leakage current at state 0 | ≤ 1mA at 220V - 50Hz | | | | |
| | Response | • from state 0 to 1 | ≤ 10ms | | | |
| | times | • from state 1 to 0 | ≤ 20ms | | | |
| | Isolation | • between output groups | 1500Veff - 50/60Hz | | | |
| | | • between outputs and bus | 1500Veff - 50/60Hz | | | |
| | | type | Relays | | | |
| | Built-in protection | • against inductive AC overvoltages | MOV peak limiter on each output | | | |
| | Recommended external protection | • against shorting and overloads | Each output is fitted with a quick-acting fuse | | | |
| | | • against inductive DC overvoltages | Discharge diode on the terminals of the output device | | | |
| | Compatibility with 24VDC PLC inputs | yes | | | | |

In future CEI standards, the AC11 duty cycle will become AC14 and DC11 will become DC13. The I/O characteristics are given for a load rating of 60% (number of I/O at state 1 in relation to the total number of I/O).

5 Technical Characteristics

Discrete Output Characteristics (Cont'd)

| Triac output characteristics | Extension module | TSX DSF 604 | |
|--|-------------------------------------|---|--------------------------------|
| | | Type of outputs | Triac |
| Display of each output, PLC side | AC loads | • type | inductive |
| | | • rated voltage | 110 - 120V |
| | | • rated current/point | 1A (*) |
| | | • rated frequency | 50/60Hz |
| | Max. values | • voltage | 93.5 - 132V |
| | | • peak load when triggered | 10A over 2 cycles, 1 time/sec. |
| | | • total module load | 3A max. (*) |
| | | • frequency | 47 - 63Hz |
| | Response times | • from state 0 to 1 | 1/2 period + 0.5ms |
| | | • from state 1 to 0 | < 1/2 period |
| Current leak at 0 | | < 3mA | |
| Loss current | • I rated > 50mA | < 3V | |
| | • 25mA < I rated < 50mA | < 13V | |
| Built-in protection | • against inductive AC overvoltages | MOV and RC peak limiter on each output | |
| Recommended external protection | • against shorting and overloads | Each output is fitted with a quick acting fuse, rated < 3.15A | |
| Compatible with TSX Series 7 PLC 110VAC PLC inputs | | yes | |
| Meets international standards | | CEI 65A, NFC 63850, UL, CSA | |
| Isolation | • between outputs | 1500Veff 50/60Hz | |
| | • between outputs and bus | 1500Veff 50/60Hz | |
| | • type | optical coupler | |

(*) temperature derating if $\Theta_A = 40$ degrees C:

- | | | |
|------------------|--------------|---------------------------------------|
| • per point: | 0.017A/deg.C | I/point = 1-0.017 x (Θ_A-40) |
| • in the module: | 0.007A/deg.C | I/point = 3-0.007 x (Θ_A-40) |

The I/O characteristics are given for a load rating of 60% (number of I/O at state 1 in relation to the total number of I/O).

5 Technical Characteristics

5.5 Compatibility with Telemecanique Sensors

This page presents a selection of the most frequently used Telemecanique sensors which are directly compatible with the 24VDC and 110VAC inputs of the TSX 17. For other Telemecanique products which are also directly compatible, consult the specialized catalogs available from your local Telemecanique Sales and Service Office.

Ranges (Sn) for inductive sensors are given in mm.

Inductive proximity sensors

Cylindrical sensors form A

Conforming to Cenelec standards EN 50040 (2-wire) EN 50008 (3-wire)

| Series | Voltage | Type | Sn | Ø4.5 and 6.5 Sn | Ø8 Sn | Ø12 Sn | Ø18 Sn | Ø30 | | | | |
|------------------|---------|--------|-----|-----------------|-----------|------------|------------|-------------|------------|-------------|------------|------------|
| Metal case | DC | 2-wire | - | - | 2 | XSA-C02712 | 5 | XSA-C05712 | 10 | XSA-C10713 | | |
| | | 3-wire | 1 | XSL-H0131 | 1 | XSA-H0131 | 2 | XSA-H0231 | 5 | XSA-H05712 | 10 | XSA-H10713 |
| | | | - | - | - | - | 5 | XSA-H05713B | 10 | XSA-H10713B | | |
| AC | 2-wire | - | - | 2 | XSA-A0291 | 5 | XSA-A0510 | 10 | XSA-A10011 | | | |
| Plastic case | DC | 3-wire | - | 1.5 | XSP-H0131 | 4 | XSP-H0431 | 8 | XSP-H0831 | 10 | XSP-H1531 | |
| Short metal case | DC | 2-wire | - | - | 2 | XSM-C02713 | 5 | XSM-C05713 | 10 | XSM-C10713 | | |
| | | 3-wire | 0.8 | XSL-H0831 | - | 2 | XSM-H02713 | 5 | XSM-H05713 | 10 | XSM-H10713 | |
| | | | 0.8 | XSM-H0831 | - | 4 | XSM-H04713 | 8 | XSM-H08713 | 15 | XSM-H15713 | |

Rectangular sensors forms C and D

Conforming to Cenelec standards EN 50025 and 50026

| Type | Voltage | Sn | Form C Sn | Form D Sn | Form D (adjustable range) |
|-----------|---------|----|-------------|----------------|---------------------------|
| 2 wire DC | - | 15 | XSC-C157139 | 40 XSD-C407139 | 30 to 60 XSD-C607139 |
| 3 wire | - | 15 | XSC-H157339 | 40 XSD-H407339 | - |
| 3 wire | - | 20 | XSC-H207339 | - | - |
| 2 wire AC | - | 15 | XSC-A150519 | 40 XSD-A400519 | 60 XSD-A600519 |

Sensors for special applications, 2-wire with plastic case (except for XSG, 3-wire with sensing face on edge).

| Detection voltage | Compact, with terminals | | Compact, with leads | | Compact, plug-in | | | | |
|-------------------|-------------------------|-------------|---------------------|----|-------------------|-------------|-------------|----|------------|
| | Sn | | Shielded Voltage | Sn | Detection Voltage | Sn | | | |
| end face DC | 10 | XSE-C107130 | yes | DC | 2 | XSG-H023100 | end face DC | 13 | XSB-C10710 |
| side face | 10 | XSE-C107133 | no | AC | 4 | XSG-H043100 | side face | 25 | XSB-C25710 |
| end face AC | - | - | yes | AC | 2 | XSG-A020110 | end face AC | 13 | XSB-A10511 |
| | | | no | AC | 4 | XSG-A040110 | side face | 25 | XSB-A25811 |

5 Technical Characteristics

Compatibility with Telemecanique Sensors (Cont'd)

Photo-electric sensors


XUB



Ranges (Sn) are given in meters. Barrier type sensors require both transmitter and receiver, reflex sensors require reflectors only.

| Type | Voltage | Sn | cylindrical, short range | Sn | rectangular, short range | Sn | rectangular, medium range | Sn | rectangular, long range |
|-----------|---------|------|--------------------------|-----|--------------------------|-----|---------------------------|-----|-------------------------|
| Barrier | DC | 4 | XUP-H043134 | 6 | XUH-H063134 | 8 | XUG-H063134 | 30 | XUE-H307534 |
| | AC | 4 | XUB-A040114 | - | - | - | - | - | - |
| Reflex | DC | 2 | XUB-H02313 | 2 | XUH-H02313 | 4 | XUG-H04313 | 10 | XUE-H10753 |
| | AC | 2 | XUB-A02911 | 2 | XUH-F02531 | - | - | 10 | XUE-A10053 |
| Proximity | DC | 0.08 | XUP-H083135 | 0.2 | XUP-H203136 | 0.3 | XUG-H303135 | 1.5 | XUE-H017535 |
| | AC | 0.08 | XUB-A089215 | - | - | 0.3 | XUG-A300215 | - | - |

Incremental encoders



The output signals from the Telemecanique incremental encoders listed below are directly compatible with the built-in 24V fast counter input of the TSX 17-20

| | | |
|-------------|--------------------------|------------------------------|
| XCC - H. H. | (PNP transistor output), | 24VDC supply |
| XCC - H. R. | (NPN transistor output), | 24VDC supply |
| XCC - H. S. | (NPN transistor output), | 5VDC not supplied by the PLC |

The other numbers in the reference number represent the diameter of the axis, the connection position and the resolution: refer to the Telemecanique catalog for further information.


5 Technical Characteristics

5.6 Compatibility with Telemecanique Actuators


All of the selected actuators listed on this page are directly compatible with the relay and transistor outputs of TSX 17 programmable controllers. To allow the use of actuators that are not compatible, the Telemecanique LA1 range of electromechanical and electronic interfaces is available. For further information refer to the Telemecanique catalog.

Electromechanical output devices

Integral 32 and 63-Contactors-Auxiliary contactors-Relays



| AC control circuit | | | |
|--------------------|-------------------------------------|--|--|
| Switching devices | Integral 32 63 | Contactors Modular Series E Series D GC1-M LC-E LC-D09 GY1-M to D080 | Aux. contactors & relays CA2-E CA2-D CA2-F RH CA2-E1 CA2-D1 CA2-FN1 RH-411 |
| Relay outputs | 24VAC 48VAC to 240VAC | | |
| Triac outputs | 110VAC | | |
| DC control circuit | | | |
| Switching devices | Integral 32/63 for low level inputs | Contactors Modular Series E Series D LP-E LP-D12 LP-D25 LP-D40 | Aux. contactors & relays CA2-E CA2-D CA2-F RH CA2-E CA2-D CA-FN2 RH-412B |
| Relay outputs | 24VAC | | |
| Transistor outputs | 24VDC 0.35A 24VDC 1 & 2A | | |



Pneumatic output devices

Electrically controlled pneumatic distributors - Electrovalves
Low power consumption modular electro-pneumatic interfaces



| Device | Distributors | Plug-in electrovalves | Interface |
|----------------------|-----------------------------------|-----------------------|------------------------------------|
| AC switching devices | 1/8" PVA-F101 PRS-M101 | 1/8"-1/4" PVA-G101 | 1/4" 3/8" 1/2" PS1-E1301 PS1-E1.01 |
| Relay outputs | 24- 240VAC | | |
| Triac outputs | 110VAC | | |
| DC switching devices | PVA-F102B PRS-M102B | PVA-G102B PVA-E102B | PS1-E1302B PS1-F1.02B |
| Relay outputs | 24VDC | | |
| Transistor outputs | 24VDC 0.35A 24VDC 1 & 2A | | |

Variable speed drives



ALTIVAR variable speed drives for standard 3-phase asynchronous motors

| Types of drives | Use of relay outputs |
|--|--|
| ATV25: 0.37 to 2.2KW 220V 50/60Hz single-phase supply | <ul style="list-style-type: none"> for switching reference signals for controlling logic commands: <ul style="list-style-type: none"> - forward, reverse - injecting DC (ATV45 only) |
| ATV45: 0.75 to 22KW 380/415V 50/60Hz three-phase supply | <ul style="list-style-type: none"> Use of analog outputs (TSX ASG) To display speed instructions <ul style="list-style-type: none"> by voltage outputs on ATV25 by voltage or current outputs on ATV45. |

6 Service Conditions

6.1 Standards


The TSX 17 programmable controller conforms to all the principal national and international standards and recommendations concerning industrial electronic control equipment, including:



| | | | |
|-----------------------|--|----------------|--|
| France: | NFC 63 850 | U.S.A.: | UL 508 UL 746C UL 94 NEMA ICS 3 304 |
| International: | CEI 664 CEI draft standards for PLCs 65A, 68 and 69 | Canada: | CSA 22.2 n° 142 |

6.2 Environment - Normal Service Conditions

Climatic environment



| | | |
|---|---------------|------------------|
| Normal temperature conditions | TSX 17 | TSX T317 |
| ⊖ A for operation | 5°C to 55°C | 5°C to 40°C |
| ⊖ A for storage | -25°C to 70°C | -25°C to 70°C |
| ⊖ A : temperature of local air (see diagram), not to be confused with | | |
| ⊖ R : ambient temperature outside the enclosure. | | |
| Normal conditions of relative humidity and altitude | | |
| Relative humidity (without condensation) | | 30 to 95% |
| Altitude | | 0 to 2000 meters |


Vibrations

The vibration tests described below have been carried out on the TSX 17 only and not on its peripherals, mounting frame or enclosure.

| Sinusoidal frequency along 3 axes | 5Hz | 57Hz | 150Hz |
|-----------------------------------|---------------|------|-------|
| Test values | | | |
| Amplitude | 75µm constant | | |
| Acceleration | 1g constant | | |
| Test values | | | |
| Amplitude | 15µm constant | | |
| Acceleration | 0.2g constant | | |

Qualification tests effected in sweeps of 5 to 150Hz, 10 sweeps per axis at 1 octave per minute.

Mechanical shocks



The term mechanical shocks includes jolting, hammering, knocking over, dropping and impacts. For definitions refer to CEI draft standards on programmable controllers 65A, 68 and 69.

| Nominal voltage | Operating range | Frequency range | Harmonic distortion | Micro-cuts: duration | repetition |
|-----------------|-------------------|-----------------|---------------------|----------------------|------------|
| 110 to 240VAC | 90 to 264VAC | 47 to 63Hz | 10% | 10ms | 1Hz |
| 24VDC | 19.2 to 30VDC (1) | | | | |

(1) Including ripple

6 Service Conditions

6.3 Reliability

The TSX 17 micro-PLC is designed and built by Telemecanique to the highest standards of safety, reliability and maintainability possible using state of the art technology.

Reliability

The reliability of a device is its ability to accomplish its required function in defined conditions during a given time. Irrespective of the manufacturer and the number of precautions that are taken (selection of components, systematic testing, quality control, high temperature burn-in etc.), the failure rate is never zero. A certain number of failures must therefore be expected to occur during the life of a programmable controller. Consequently, the necessary precautions should always be designed into an application so as to reduce the possibility of faults occurring and to limit the consequences of any failure, particularly where safety is concerned.

Built-in self-tests

The TSX 17 is equipped with a series of built-in self-tests capable of detecting the majority of internal failures and operator errors that can occur during start-up, normal operation and maintenance of the automated system. These tests are performed at power-up, or during one or more scan cycles, and mainly concern:

- the processor: operational monitoring of the microprogram, the internal RAM memories (checksum), and the watchdog,
- the user RAM memory: check of contents before and after the power break, if the configuration is fitted with a memory cartridge, its contents are transferred to the RAM if a test of their contents shows them to be different.
- the I/O: check extension block power supply presence and data exchange on the I/O bus.

Diagnostic aids

The results of these self-tests, depending on their importance, are



- indicated by LEDs on the front panel of TSX 17 components,
- available to the user program through the system bits,
- blocking if they cause the PLC program scan cycle to stop and reset the outputs (if SY8=1).

It is also recommended that the full power of the PL7 software be used to provide automated assistance with troubleshooting (especially to find problems caused by failures external to the PLC, these account for 90 % to 95 % of such failures.

6 Service Conditions

6.4 Safety –System Availability

Safety

A system is said to be totally safe if the appearance of faults can never lead to a dangerous situation.

The operational safety of a device is its ability to avoid the appearance of faults and to minimize their effects when they occur.

An internal fault in a control system can be classified as belonging to one of two types:

- passive if the fault results in an open circuit output (no signal sent to output devices),
- active if the fault results in a closed circuit output (signal sent to output devices),

Whether or not a given type of fault can be considered dangerous will depend on the function of the output concerned. A passive fault is dangerous if the normal function of the signal is to control an alarm. An active fault is dangerous if it maintains an undesired signal.

Furthermore, it is important to appreciate the fundamental difference in behaviour between an electromechanical relay and an electronic component (such as a transistor for example):

- there is high probability that a fault in a relay will produce an open circuit (controlled circuit not powered),
- but there is an even probability that a fault in a transistor will produce an open circuit, it is just as likely to produce a closed circuit.

For this reason, it is important to correctly determine the nature and consequences of possible faults when designing an automated system controlled by a solid-state device such as a programmable controller.

The system designer should provide protection against any internal active faults in the PLC which may not be indicated, or which may be dangerous for the application, by incorporating external protective devices. These protective devices may use several different technologies such as mechanical, electromechanical, pneumatic, hydraulic or electronic (for example, wiring a limit switch and emergency stop button to the coil of a motion control contactor).

System availability

The availability of a system is its ability to accomplish a required function at any given moment and during any given period, and includes considerations of reliability, maintainability and maintenance policy. System availability is therefore specific to each application, since it depends on:


- the architecture of the automated systems,
- the reliability and maintainability of the hardware used (PLCs, sensors, actuators, machines, etc.),
- the user's maintenance policy and logistic back-up (software structure, failure indication and warning systems, availability of spare parts, training of maintenance personnel, etc.).

7 Appendix

7.1 Isolation Transformer Equipped Power Supply

Although TSX Series 7 PLCs meet the electromagnetic interference standards defined in CEI 65A and NFC 63 850, in industrial applications where high levels of interference are encountered, it may be necessary to fit an isolation transformer to the power supply.

If an isolation transformer is fitted, the wiring diagram shown on page 32 is changed to look like:

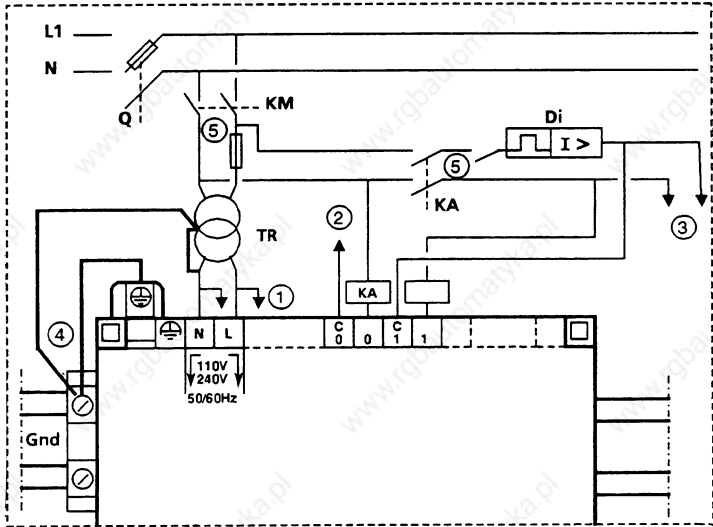

(5) 275 V, 90 joule MOV peak limiting circuit to locate as close as possible after the KM and KA circuit breakers.

When a DC supply is used, refer to the connection diagram on page 31, and add a discharge diode protection circuit after the KM and KA circuit breakers.

High Impedance Grounded Neutral System

An isolating transformer is mandatory when using certain versions of TSX 17 PLCs with a high impedance grounded neutral system. The connection diagram is the same as that shown above.

The following TSX 17 PLCs are affected by this requirements:


- TSX 171 2028 software version II < 06,
- TSX 172 2028/3428 software version II < 07,
- TSX DMF 342A software version II < 05.

7 Appendix

7.2 TSX 17 ACC2 Display

Programming Example

Depending on the state of input I0,2, this routine will display either the value of word W0 or the current value of counter C0,V.

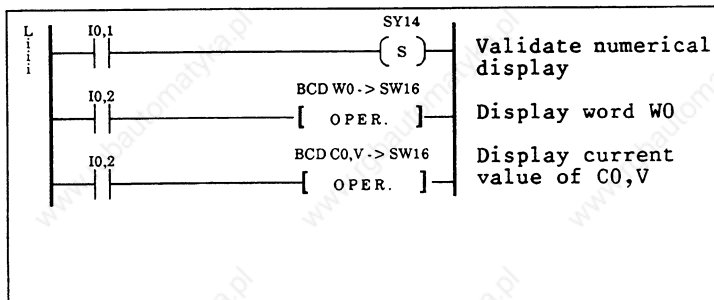

Note: Refer to page 12 for instructions on how to install the TSX 17 ACC2 display module. This display can be fitted to any TSX 17-20 PLC except TSX 172 2028/3428/2012/4012 software version II < 05.

TSX 17 Micro-PLC Installation Manual

Notes


Apart from the specific product features indicated on this follow-up sheet, the general instructions for installing the TSX 17B 1428 Micro-PLC are the same as those given in the TSX D11 000E Installation Manual.

1 Planning the Installation (see Section 1 in TSX D11 000E)


1.1 Description of TSX 17B 1428 PLC

These systems comprise:

- a 110/240 VAC power supply ① that provides a 24 VDC, 250 mA supply output ② for 24 VDC sensors connected to the TSX 17,
- a CPU with programming port ③ and status display ④,
- an internal 24 Kbyte RAM program memory (and 2 Kbytes of data) that can be backed up. The battery is located in ⑤ and has a 1 year service life.
- a location ⑥ for a plug-in EEPROM or EPROM memory cartridge for saving user programs,
- a location ⑭ for a PL7-2 software cartridge containing the BATIBUS function,
- 14 discrete I/O with front panel status display ⑨:
 - 12 isolated 24 VDC inputs ⑦
 - 2 relay outputs ⑧
- a BATIBUS network ⑫ with front panel status display ⑩,
- a 15 V, 150 mA power supply ⑬ energizing the BATIBUS network,
- a 9-pin I/O bus extension connector ⑪,
- 2 removable terminal strips ⑬ with captive screw terminals,
- a ground connector ⑮.

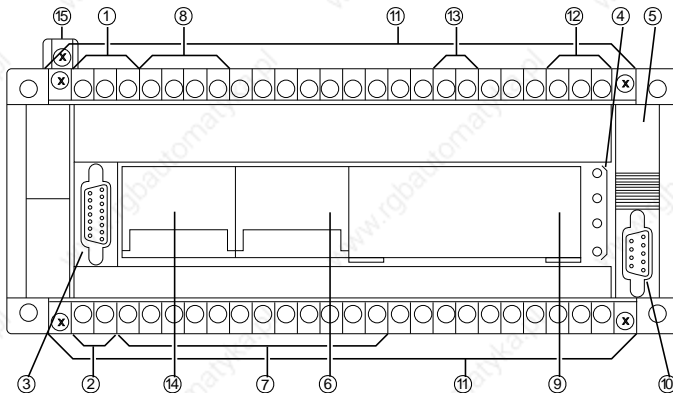

1.2 BATIBUS Network Status Display

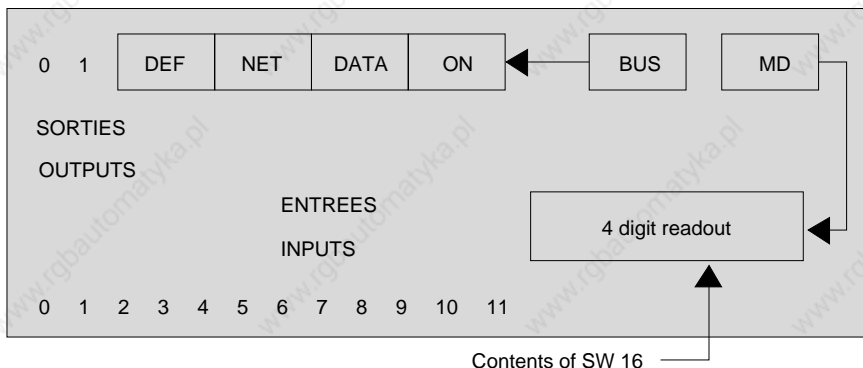

DEF

This LED comes on when there is a BATIBUS fault

NET

This LED comes on when one of the system components is faulty, i.e. no acknowledgement or BATIBUS interface problem

DATA

This LED flashes during transmission or reception

ON

This LED comes on when the line is energized by 15 V. It thus permits detection of line short-circuits and of a cross-connected module.


Important

The contents of word SW16 can be displayed in 4 digit BCD format by setting SY 14 to state 1 through PL7-2 programming. In this case the status display of both outputs (0,1) and of the BATIBUS network (DEF, NET, DATA, ON) is no longer active.

2 Mounting

- Basic PLC/extension compatibility: as for TSX 172 3428 (see Section 2.3 in TSX D11 000E Manual)
- overall dimensions: as for TSX 172 3428 (see Section 2.4 in TSX D11 000E Manual)

3 Wiring (see Section 3 - TSX D11 000E)

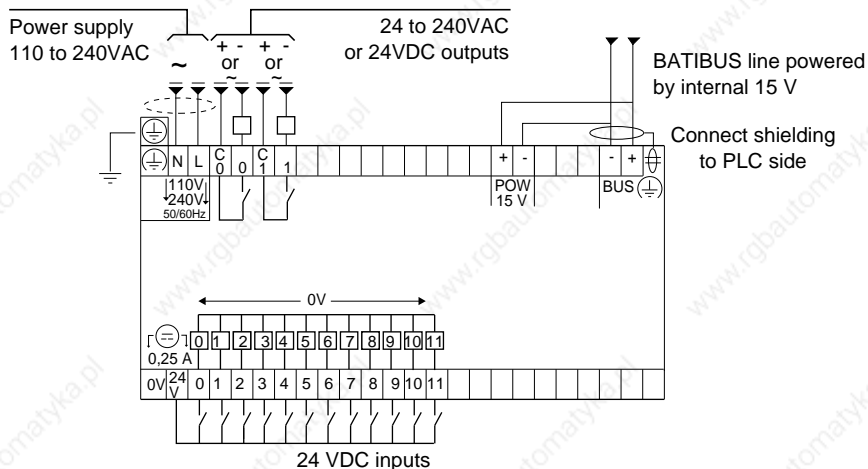

4 Setting into Service - Maintenance

(See Section 4 in TSX D11 000E)

5 Technical Characteristics

- 5.1 **Power Supply Characteristics:** the same 110/240 V power supply as for TSX 172 3428 (see Section 5.1 in TSX D11 000E)
- 5.2 **24 VDC Input Characteristics:** as for TSX 172 3428
- 5.3 **Discrete Output Characteristics:** relay outputs as for TSX 172 3428
- 5.4 **BATIBUS Network Characteristics**
 - 5.4.1 **Principle of Coding/Decoding**

The modules in the network are powered by 15 V supplied by the TSX 17B 1428 PLC. Modulation is achieved by pinching off the **powered line**. The physical layer transmits or receives the coded frames.

- Line at rest : 15 V (logic state of 0)
- Pinched line : 0 V (logic state of 1)

5.4.2 15 V Power Supply Characteristics

- No load voltage 15.5 V ± 10%
- Voltage under load 13.8 V min. at 150 mA
- Pinch-off current 300 mA ± 10%
- Isolation between mains and bus 4000 Vrms
- Capacitance between line and mains 50 pF

5.4.3 BATIBUS Line Characteristics

- Transmitter Network
 - Voltage across line terminals at pinch-off 1.5 V max. with 330 mA
 - Leakage current on line at rest 50 µA at 18 V
- Receiver Network
 - Input resistance 500 KΩ max.
 - Line resistance 12 Ω max. between power supply and most distant point
 - Line voltage drop 3.6 V max.
 - Line capacitance 250 nF max.
 - Spurious capacitance at a point 50 pF max.
 - Pinch-off-to-breakdown and breakdown-to-pinch-off switchover times 2 µs min., 5 µs max. with no load on line
 - Modulation rate 4800 bps (bits per second)

5.4.4 Recommended Cable

- BATIBUS cable (P/N 63715) marketed by Merlin Gerin.

| Name | Area mm ² | Isolation (1) | Type or shielding | Screen | I m | L m | R/km |
|---------|----------------------|---------------|-------------------|--------|-----|------|------|
| BATIBUS | 0.75 | 4 KV | flexible | yes | 250 | 1900 | 46.2 |
| BATIBUS | 1.5 | 4 KV | flexible | yes | 500 | 2500 | 24.2 |
| BATIBUS | 2.5 | 4 KV | flexible | yes | 600 | 2500 | 15.2 |

- I : max. length from processor (or sub-station) to most distant BATIBUS point.
 L : max. length of overall BATIBUS network.
 (1) : isolation between the conductors and the screen or shielding when present; otherwise between the conductors and the outside surface of the wire.

5.4.5 Special Wiring Precautions

Whenever possible keep the BATIBUS cable at least 20 cm away from power cables.

6 Service Conditions

(see Section 6 in TSX D11 000E)

The general rules for installing a TSX DMF 242A I/O extension block are the same as those described in the TSX 17 Micro-PLC Installation Manual (TSX D11000E). Specific differences that only apply to the TSX 171 2022 are described in this sheet.

1. Planning the Installation


(see Section 1 TSX 17 Installation Manual).

Description

24 discrete I/O, 110 VAC inputs, relay outputs, AC power supply.

This extension block comprises :

- a 110/240VAC power supply ① that provides a 24 VDC, 250mA sensor supply output ②,
- 24 discrete I/O with a front panel status display ⑤,
- 8 isolated 110VAC inputs ③,
- 16 relay outputs ④,
- an I/O bus connection or extension block fault LED ⑩,
- a 15-pin I/O bus input connector ⑥,
- a 9-pin I/O bus output connector ⑦,
- 2 removable terminal blocks with captive screw-terminals ⑧,
- a ground connector ⑨.

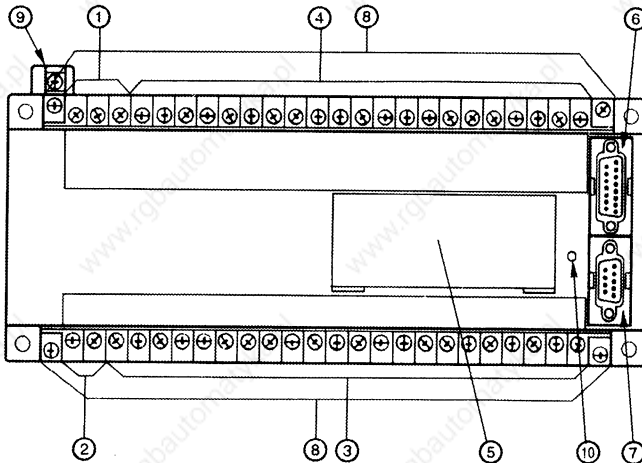

2. Mounting

(see Section 2 TSX 17 Installation Manual).


- Basic-PLC/Extension Compatibility : identical to TSX DMF 342 A (see Sub-section 2.3 TSX 17 Installation Manual),
- Dimensions : identical to TSX DMF 342 A (see Sub-section 2.4 TSX 17 Installation Manual).

3. Raccordements

(voir chapitre 3 TSX D11 000F)

3. Wiring

(see Section 3 TSX 17
Installation Manual)

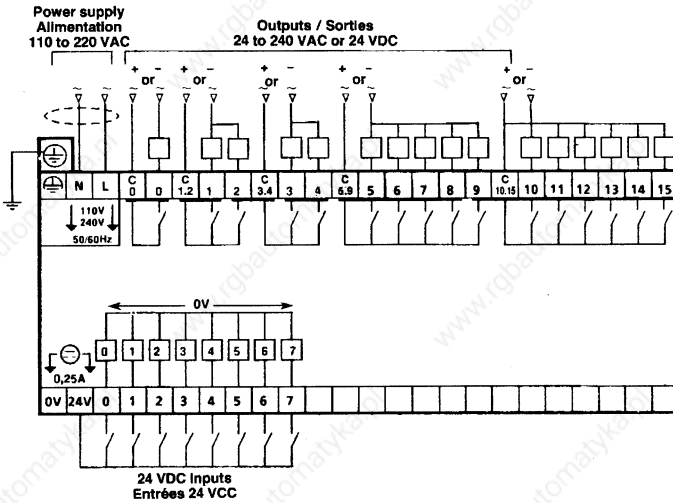

4. Mise en service - Maintenance

(voir chapitre 4 TSX D11 000F)

4. Setting into Service - Maintenance

(see Section 4 TSX 17 Installation
Manual)

5. Conditions générales de mise en oeuvre

(voir chapitre 5 TSX D11 000F)

- alimentation 110/240VCA :
identique à DMF 342 A
(voir chapitre 5.1 TSX D11 000F)
- entrées 24 VCC :
identique à TSX DMF 342 A
(voir chapitre 5.2 TSX D11 000F)
- sorties relais :
identique à TSX DMF 342 A
(voir chapitre 5.4 TSX D11 000F)

5. Technical Characteristics

(see Sub-section 5 TSX 17
Installation Manual)

- 110/240VCA Power Supply :
Identical to TSX DMF 342 A
(see Sub-section 5.1 TSX 17
Installation Manual)
- 24VDC Inputs :
Identical to TSX DMF 342 A
(see Sub-section 5.2 TSX 17
Installation Manual)
- Relay outputs :
Identical to TSX DMF 342 A
(see Sub-section 5.4 TSX 17
Installation Manual)

6. Conditions de service

(voir chapitre 6 TSX D11 000F)

6. Service Conditions

(see Section 6 TSX 17 Installation
Manual)